


**BATH NOTES**

- TILE FLOORS (AT WET AREAS).
- TILE WALLS AT TUB (SECONDARY BATHS).
- TILE TO 8'-6" AT SHOWER.
- SOLID SURFACE COUNTER TOPS AND SPLASHES.
- ALL GLASS AT TUBS AND SHOWERS SHALL BE TEMPERED SAFETY GLASS AND MUST COMPLY WITH R308 (IRC 2006).
- SHOWER STALLS AND TUB (WITH SHOWER HEADS) WALLS TO BE FINISHED WITH NON ABSORBENT SURFACE TO A HT. OF NOT LESS THAN 72" ABV. DRAIN INLET OVER CONCRETE BACKERBOARD R307 (IRC 2006).
- ALL PLUMBING FIXTURES SHALL BE SPACED PER R307.2 (IRC 2006).

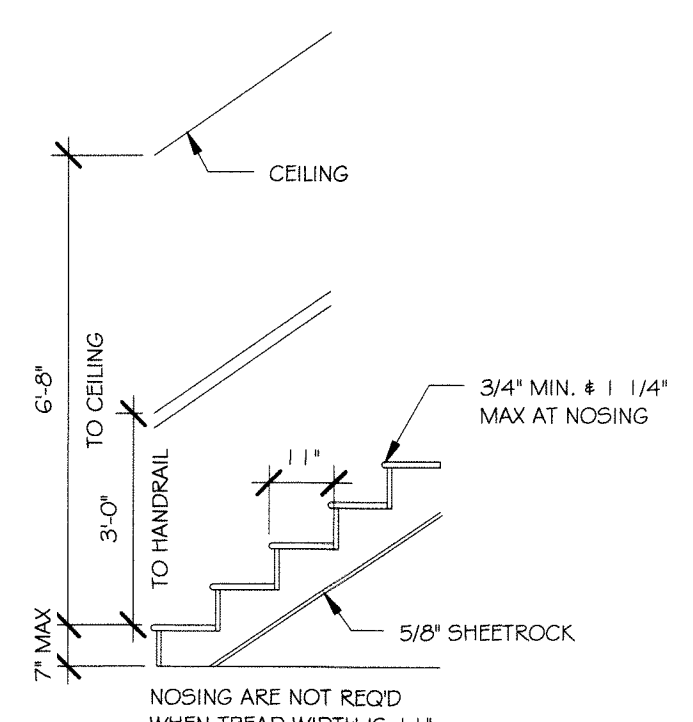

**3 STAIR - SECTION**  
3/8" = 1'-0"

STAIRWAYS SHALL COMPLY W/ SECTION R311 OF THE IRC.. RISERS SHALL NOT EXCEED 7 3/4" IN HEIGHT. THE DEPTH SHALL BE MEASURED NOSE TO NOSE @ SHALL BE LESS THAN 10". THE MINIMUM HEADROOM CLEARANCE SHALL NOT BE LESS THAN 6'-8". TREAD WIDTHS FOR WINDERS SHALL BE 1'0" MEASURE 12" IN FROM THE NARROWEST POINT & SHALL NOT BE LESS THAN 6" AT THE POINT. TREAD WIDTH FOR CIRCULAR STAIRS SHALL BE 11" MIN. AS MEASURED FOR WINDERS.

As indicated

1 LEVEL 2  
1/4" = 1'-0"

10935 Britoak  
Aston Residence

Level 2  
Sheet 5 of 12