


RD01.3 Drainage: Surface drainage shall be directed to a storm sewer conveyance or other approved point of collection that shall not create a hazard. Lots shall be graded to drain surface water away from foundation walls. The grade shall fall a minimum of 6 inches (152 mm) within the first 10 feet (3048 mm).
Exceptions: Where for lines, walls, slopes or other physical barriers prohibit 6 inches (152 mm) of fall within 10 feet (3048 mm), drains or swales shall be constructed to ensure drainage away from the structure. Impervious surfaces shall be sloped a minimum of 2 percent away from the building.

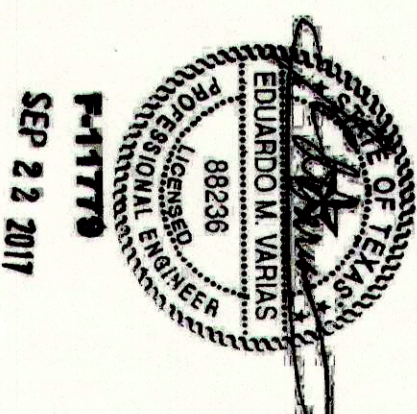

CITY OF HUNTSVILLE
 CENTRAL INSPECTIONS
 APR 2 2008
 RECEIVED

REVISION	DATE

SITE PLAN
 Lot 32, Block 26, Section 3
 Elkins Lakes Subdivision
 Huntsville, Texas
 Central Texas Consulting
 99 Spring Creek Lane
 Austin, Texas 78745
 936-299-0278 fax 936-291-7321

DATE	DRAWN BY	APPRO BY	SCALE	SHEET
9/19/2017	DWC	EV	1" = 10'	C-1