


ALTERNATE SEPTIC DESIGN OPTION

Blue Water Works 1-936-646-5115


Sleeve water line or sewer line any place where they are closer than 10 feet.
 Tanks may be moved within reason to expedite installation and minimize damage to hardscapes.
 Set exact trenches locations to minimize damage to mature trees



Drawing Ruler is good at any scale of viewing




With this alternate option, all spray heads would be removed and replaced with a drip field at the rear of the lot, freeing up the front portion (approx. 55') for use.

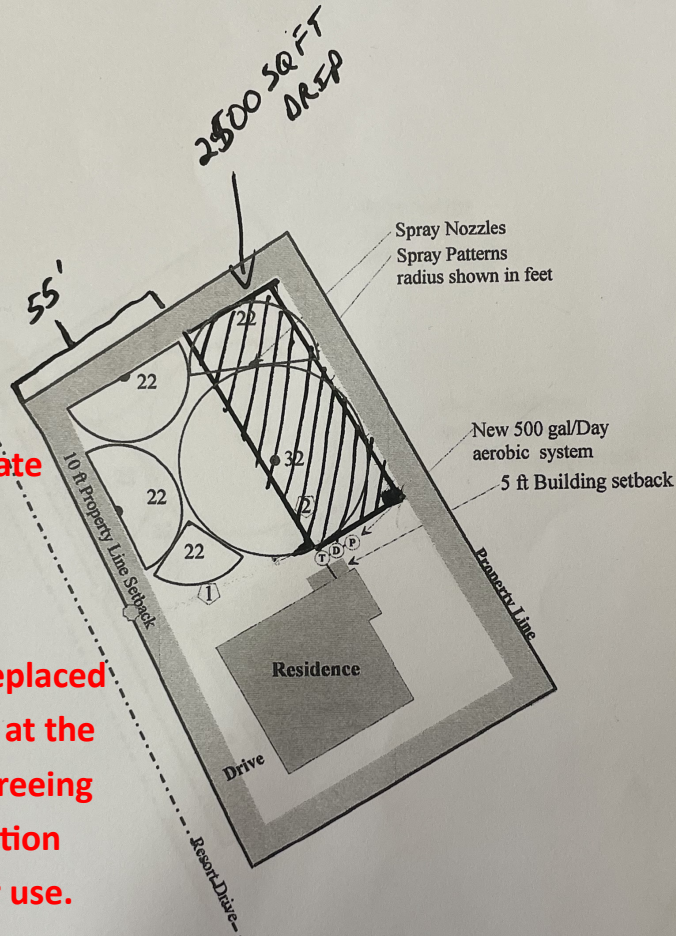

★ Subsurface survey pins located and flagged
Selected Setbacks Shown in Gray

Icon Key: Not to Scale

	Gate Valve		Clean Out
	Inspection Port		Water Meter
	P - Pump Tank		Boring
	D - Digestion Tank		Elevations
	T - Trash Tank		Tr - Tree



Ronald Cobb

Blue Water Works L. L. C. Ronald F. Cobb R. S. # 3575 L. I. # 6066	
Job Number: S082421 Vega	County: Polk
Location: 380 Resort Drive	
Subdivision: Resort Country	
GPS North: 30.714049	West: 95.101132