



Inspection Report

Zane O'Keefe

Property Address:
29119 Korsman Landing Dr.
Katy TX 77494



WELCOME HOME

JASE Home Inspections

Jason Autrey T.R.E.C. #20981
15529 Queen Elizabeth Ct.
Montgomery, Tx. 77316
281-906-7168

PROPERTY INSPECTION REPORT

Prepared For: Zane O'Keefe
(Name of Client)

Concerning: 29119 Korsman Landing Dr., Katy, TX 77494
(Address or Other Identification of Inspected Property)

By: Jason Autrey T.R.E.C. #20981 / JASE Home Inspections 8/25/2020
(Name and License Number of Inspector) (Date)

(Name, License Number of Sponsoring Inspector)

PURPOSE, LIMITATIONS AND INSPECTOR / CLIENT RESPONSIBILITIES

This property inspection report may include an inspection agreement (contract), addenda, and other information related to property conditions. If any item or comment is unclear, you should ask the inspector to clarify the findings. It is important that you carefully read ALL of this information.

This inspection is subject to the rules ("Rules") of the Texas Real Estate Commission ("TREC"), which can be found at www.trec.texas.gov.

The TREC Standards of Practice (Sections 535.227-535.233 of the Rules) are the minimum standard for inspections by TREC Licensed inspectors. An inspection addresses only those components and conditions that are present, visible, and accessible at the time of the inspection. While there may be other parts, components or systems present, only those items specifically noted as being inspected were inspected. The inspector is NOT required to turn on decommissioned equipment, systems, utility services or apply an open flame or light a pilot to operate any appliance. The inspector is NOT required to climb over obstacles, move furnishings or stored items. The inspection report may address issues that are code-based or may refer to a particular code; however, this is NOT a code compliance inspection and does NOT verify compliance with manufacturer's installation instructions. The inspection does NOT imply insurability or warrantability of the structure or its components. Although some safety issues may be addressed in this report, this inspection is NOT a safety/code inspection, and the inspector is NOT required to identify all potential hazards.

In this report, the inspector shall indicate, by checking the appropriate boxes on the form, whether each item was inspected, not inspected, not present or deficient and explain the findings in the corresponding section in the body of the report form. The inspector must check the Deficient (D) box if a condition exists that adversely and materially affects the performance of a system or component or constitutes a hazard to life, limb or property as specified by the TREC Standards of Practice. General deficiencies include inoperability, material distress, water penetration, damage, deterioration, missing components, and unsuitable installation. Comments may be provided by the inspector whether or not an item is deemed deficient. The inspector is not required to prioritize or emphasize the importance of one deficiency over another.

Some items reported may be considered life-safety upgrades to the property. For more information, refer to Texas Real Estate Consumer Notice Concerning Recognized Hazards or Deficiencies below.

THIS PROPERTY INSPECTION IS NOT A TECHNICALLY EXHAUSTIVE INSPECTION OF THE STRUCTURE, SYSTEMS OR COMPONENTS. The inspection may not reveal all deficiencies. A real estate inspection helps to reduce some of the risk involved in purchasing a home, but it cannot eliminate these risks, nor can the inspection anticipate future events or changes in performance due to changes in use or occupancy. It is recommended that you obtain as much information as is available about this property, including any seller's disclosures, previous inspection reports, engineering reports, building/remodeling permits, and reports performed for or by relocation companies, municipal inspection departments, lenders, insurers, and appraisers.

Promulgated by the Texas Real Estate Commission(TREC) P.O. Box 12188, Austin, TX 78711-2188 (512)936-3000
(<http://www.trec.state.tx.us>).

You should also attempt to determine whether repairs, renovation, remodeling, additions, or other such activities have taken place at this property. It is not the inspector's responsibility to confirm that information obtained from these sources is complete or accurate or that this inspection is consistent with the opinions expressed in previous or future reports.

ITEMS IDENTIFIED IN THE REPORT DO NOT OBLIGATE ANY PARTY TO MAKE REPAIRS OR TAKE OTHER ACTIONS, NOR IS THE PURCHASER REQUIRED TO REQUEST THAT THE SELLER TAKE ANY ACTION. When a deficiency is reported, it is the client's responsibility to obtain further evaluations and/or cost estimates from qualified service professionals. Any such follow-up should take place prior to the expiration of any time limitations such as option periods.

Evaluations by qualified tradesmen may lead to the discovery of additional deficiencies which may involve additional repair costs. Failure to address deficiencies or comments noted in this report may lead to further damage of the structure or systems and add to the original repair costs. The inspector is not required to provide follow-up services to verify that proper repairs have been made.

Property conditions change with time and use. For example, mechanical devices can fail at any time, plumbing gaskets and seals may crack if the appliance or plumbing fixture is not used often, roof leaks can occur at any time regardless of the apparent condition of the roof, and the performance of the structure and the systems may change due to changes in use or occupancy, effects of weather, etc. These changes or repairs made to the structure after the inspection may render information contained herein obsolete or invalid. This report is provided for the specific benefit of the client named above and is based on observations at the time of the inspection. If you did not hire the inspector yourself, reliance on this report may provide incomplete or outdated information. Repairs, professional opinions or additional inspection reports may affect the meaning of the information in this report. It is recommended that you hire a licensed inspector to perform an inspection to meet your specific needs and to provide you with current information concerning this property.

TEXAS REAL ESTATE CONSUMER NOTICE CONCERNING HAZARDS OR DEFICIENCIES

Each year, Texans sustain property damage and are injured by accidents in the home. While some accidents may not be avoidable, many other accidents, injuries, and deaths may be avoided through the identification and repair of certain hazardous conditions. Examples of such hazards include:

- malfunctioning, improperly installed, or missing ground fault circuit protection (GFCI) devices for electrical receptacles in garages, bathrooms, kitchens, and exterior areas;
- malfunctioning arc fault protection (AFCI) devices;
- ordinary glass in locations where modern construction techniques call for safety glass;
- malfunctioning or lack of fire safety features such as smoke alarms, fire-rated doors in certain locations, and functional emergency escape and rescue openings in bedrooms;
- malfunctioning carbon monoxide alarms;
- excessive spacing between balusters on stairways and porches;
- improperly installed appliances;
- improperly installed or defective safety devices;
- lack of electrical bonding and grounding; and
- lack of bonding on gas piping, including corrugated stainless steel tubing (CSST).

To ensure that consumers are informed of hazards such as these, the Texas Real Estate Commission (TREC) has adopted Standards of Practice requiring licensed inspectors to report these conditions as "Deficient" when performing an inspection for a buyer or seller, if they can be reasonably determined.

These conditions may not have violated building codes or common practices at the time of the construction of the home, or they may have been "grandfathered" because they were present prior to the adoption of codes prohibiting such conditions. While the TREC Standards of Practice do not require inspectors to perform a code compliance inspection, TREC considers the potential for injury or property loss from the hazards addressed in the Standards of Practice to be significant enough to warrant this notice.

Contract forms developed by TREC for use by its real estate licensees also inform the buyer of the right to have the home inspected and can provide an option clause permitting the buyer to terminate the contract within a specified time. Neither the Standards of Practice nor the TREC contract forms require a seller to remedy conditions revealed by an inspection. The decision to correct a hazard or any deficiency identified in an inspection report is left to the parties to the contract for the sale or purchase of the home.

INFORMATION INCLUDED UNDER "ADDITIONAL INFORMATION PROVIDED BY INSPECTOR", OR PROVIDED AS AN ATTACHMENT WITH THE STANDARD FORM, IS NOT REQUIRED BY THE COMMISSION AND MAY CONTAIN CONTRACTUAL TERMS BETWEEN THE INSPECTOR AND YOU, AS THE CLIENT. THE COMMISSION DOES NOT REGULATE CONTRACTUAL TERMS BETWEEN PARTIES. IF YOU DO NOT UNDERSTAND THE EFFECT OF ANY CONTRACTUAL TERM CONTAINED IN THIS SECTION OR ANY ATTACHMENTS, CONSULT AN ATTORNEY.

ADDITIONAL INFORMATION PROVIDED BY INSPECTOR:

In Attendance:

Vacant (inspector only)

Type of building:

Single Family (1 story)

Approximate age of building:

New Construction

Home Faces:

West

Temperature:

89(F)

Weather:

Cloudy

Ground/Soil surface condition:

Dry

Rain in last 3 days:

No

Location of gas meter:

Left side

Approximate square footage of home:

1,931

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

I. STRUCTURAL SYSTEMS

A survey of the foundation was done to determine the degree of level using a "Zip Level Pro 2000" elevation measurement system. (See attachment to inspection report) At the time of the inspection the foundation appears to be providing proper support for the structure at the time of the inspection. There is no guarantee on the foundation continuing to be functional. The foundation may develop additional deflection in the future. Positive drainage around the foundation is defined as 6 inches in 10 ft. Positive drainage needs to be maintained at all times to keep water from pooling around the foundation. A representative number of windows were tested. The flashing details are concealed and are not accessible. No comment is made on the integrity of the flashing details. A leak check would be required on the flashing details which is not within the scope of this inspection. All doors were opened and closed to evaluate for the presence of racking/movement. It was not determined if the access door between the house and the garage is a properly fire-rated type door. Any fireplace/chimney repairs listed in this report are based on the condition of the fireplace system(s) at the time of the inspection. The inspection of the fireplace/chimney is limited in scope due to limited accessibility to the fireplace and chimney.

A. Foundations

Type of Foundation (s): Slab on grade

Comments:

This inspection is a visual review and a level survey of the foundation and represents the opinion of the inspector, based solely on the inspector's personal experience with similar homes. The inspector does not pull up floor coverings, move furniture, or propose repairs. The inspector does not enter crawl space areas less than 18". Minor settlement or "hairline" cracks in drives, walks or even foundations are normal to properties of any age. They should, however, be monitored for expansion and sealed as necessary. Homes built with slab and/or post tension cable foundation construction may have heating ductwork, plumbing, gas, and electrical lines running beneath the slab. As it is impossible to visually inspect these items, they are specifically excluded from the scope of this inspection. The opinion stated below in no way addresses future foundation movement or settlement.

Performance of the foundation can be improved in several ways including: evenly watering the ground around all sides of the home, maintaining proper drainage around the home (ground should slope away from the foundation at least 6 inches in the first 10 feet), installing root barriers or removing large trees whose roots may soak up water and dry out the ground, and by installing a roof gutter system to remove all water run off from the roof at least 5 feet away from the foundation. Proper watering of the ground may include soaker hoses that are placed at least 12-18 inches from the foundation of the home and not directly against the foundation.

During this inspection the inspector performed a visual inspection of the exterior of the foundation (where visible), visual inspection of exterior and interior walls, the operation of some windows, and the operation of most doors. A level survey was also conducted and those numbers are attached to this report.

It is the **OPINION** of the inspector that the foundation is functioning properly at the time of this inspection and repairs to the foundation are not needed. Of course, guarantees cannot be made that the foundation will remain functional after the date of this inspection.

B. Grading and Drainage

Comments:

No defects were noted for the grading and drainage during the inspection.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D



B. Item 1(Picture) Ground properly sloped away from the home.

C. **Roof Covering Materials**

Types of Roof Covering: Architectural, Asphalt/Fiberglass

Viewed from: Walked roof

Roof Ventilation: Soffit Vents, Roof vents

Approximate age of the roof: New


Comments:

The roof inspection portion of the General Home Inspection will not be as comprehensive as an inspection performed by a qualified roofing contractor. Because of variations in installation requirements of the huge number of different roof-covering materials installed over the years, the General Home Inspection does not include confirmation of proper installation. Home Inspectors are trained to identify common deficiencies and to recognize conditions that require evaluation by a specialist. Inspection of the roof typically includes visual evaluation of the roof structure, roof-covering materials, flashing, and roof penetrations like chimneys, mounting hardware for roof-mounted equipment, attic ventilation devices, and combustion and plumbing vents. The roof inspection does not include leak-testing and will not certify or warranty the roof against future leakage. Other limitations may apply and will be included in the comments as necessary.

No defects were noted for the roof covering materials during the inspection.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

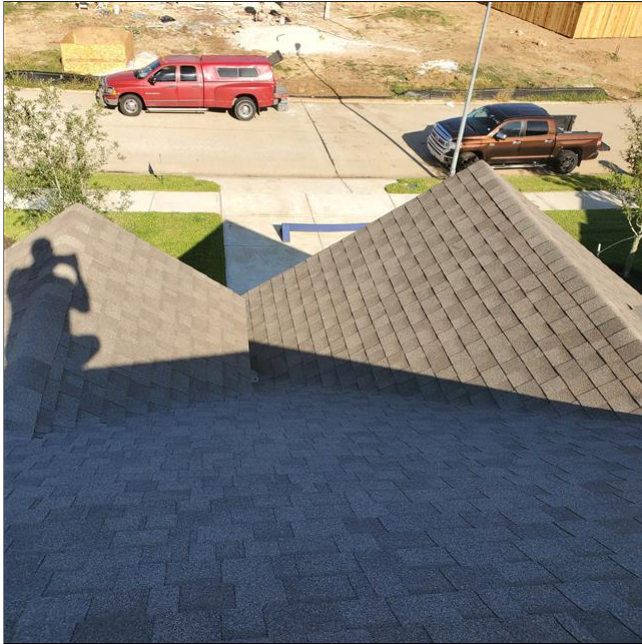

C. Item 1(Picture) Roof overview



C. Item 2(Picture) Roof overview

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D



C. Item 3(Picture) Roof overview



C. Item 4(Picture) Roof overview

D. Roof Structures and Attics

Method used to observe attic: Walked

Attic Insulation: Blown, Batt, Fiberglass

Approximate Average Depth of Insulation: 11 inches

Attic info: Pull Down stairs

Roof type: Hip

Comments:

No defects were noted for the roof structure and attic during the inspection.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D



D. Item 1(Picture) Attic overview.



D. Item 2(Picture) Attic overview.

E. Walls (Interior and Exterior)

Wall Structure: 2 X 4 Wood

Exterior walls: Brick, Stone

Comments:

The wood header is missing above a window at the left side of the home and there is a large gap in the wall. Repairs should be made immediately as wind driven rain will penetrate.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D



E. Item 1(Picture) Missing wood header here.



E. Item 2(Picture) This is a different window showing what is missing.

F. Ceilings and Floors

Ceiling Structure: 6" or better

Floor finishes: Tile, Carpet

Comments:

Damage to the grout was noted at the entry to the garage. Repairs are needed.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D



F. Item 1(Picture) Damage to flooring/grout at entry to garage.

G. Doors (Interior and Exterior)

Garage doors: 1 aluminum door

Comments:

All doors were tested and no repairs are needed at this time.

H. Windows

Comments:

Note: All windows were inspected for operation. The flashing details are concealed and not accessible. No comment is made on the integrity of the flashing details. A leak check would be required on the flashing details which is not within the scope of this inspection.

All windows functioned properly during the inspection.

I. Stairways (Interior and Exterior)

Comments:

J. Fireplaces and Chimneys

Chimney (exterior): Round chimney cap, Siding

Number of fireplaces: One

Types of Fireplaces: Metal box

Number of Woodstoves: None

Comments:

No defects were noted for the fireplace and chimney during the inspection.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D



J. Item 1(Picture) Overview of fireplace.

K. Porches, Balconies, Decks and Carports

Is there a carport?: no

Comments:

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

II. ELECTRICAL SYSTEMS

A. Service Entrance and Panels

Electrical Service Conductors: Below ground, Aluminum


Panel Type: Circuit breakers

Electric Panel Manufacturer: Square D

Main breaker: 150 AMP

Comments:

No defects were noted for the installation of the service panel. The inspector tested all AFCI breakers and all tested properly.

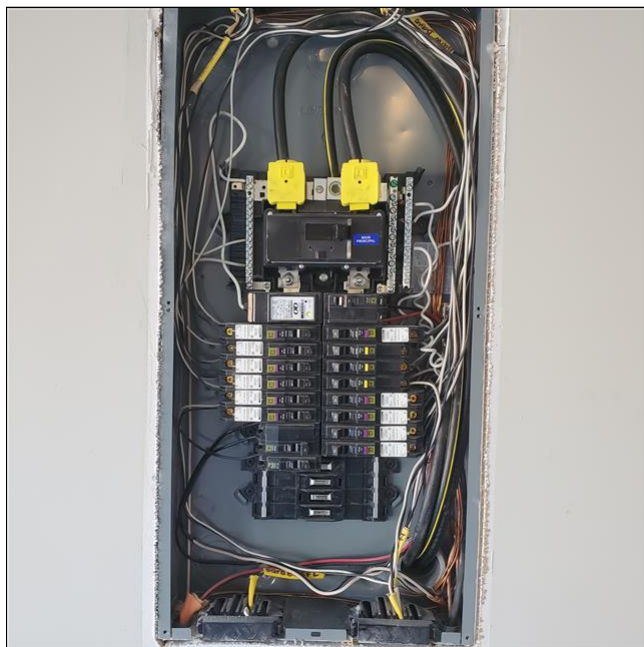

A. Item 1(Picture) Interior of service panel.

B. Branch Circuits, Connected Devices, and Fixtures

Type of Wiring: Romex

Branch wire 15 and 20 amperage: Copper

Comments:

Home branch circuit wiring consists of wiring distributing electricity to devices such as switches, receptacles, and appliances. Most conductors are hidden behind floor, wall and ceiling coverings and cannot be evaluated by the inspector. The Inspector does not remove cover plates and inspection of branch wiring is limited to proper response to testing of switches and a representative number of electrical receptacles.

All branch circuits, connected devices, and fixtures were tested and no repairs are needed at this time.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

III. HEATING, VENTILATION AND AIR CONDITIONING SYSTEMS

Temperature drops were conducted on the A/C unit(s) at the time of the inspection if the outside temperature was greater than 65 degrees Fahrenheit. A full evaluation of the integrity of the heat exchanger(s) requires dismantling the entire furnace(s) and is beyond the scope of this inspection. The average life of a heat exchanger in the Houston area is 15 years. If there are gas appliances in the structure it is strongly recommended that carbon monoxide detectors be installed.

A. Heating Equipment

Type of Systems: Forced Air

Energy Sources: Gas

Heat System Brand: Carrier

Number of Heat Systems (excluding wood): One

Size of unit #1: 3 ton

Comments:

The general home inspection does not include any type of heating system warranty or guaranty. Inspection of heating systems is limited to basic evaluation based on visual examination and operation using normal controls. Report comments are limited to identification of common requirements and deficiencies. Observed indications that further evaluation is needed will result in referral to a qualified heating, ventilating, and air-conditioning (HVAC) contractor.

Inspection of heating systems typically includes: system operation: confirmation of adequate response to the thermostat; proper location; proper system configuration; component condition exterior cabinet condition; fuel supply configuration and condition; combustion exhaust venting; air distribution components; and proper condensation discharge.

No defects were noted for the installation of the heating system. Heating systems are not operated when the outdoor temperature exceeds 80 degrees. No representation is made as to the working condition of the heating system.



A. Item 1(Picture) Overview of heating system.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

B. Cooling Equipment


Central Air #1 Manufacturer: Carrier

Comments:

(1) *The air conditioning system was a split system in which the cabinet housing the compressor, cooling fan and condensing coils was located physically apart from the evaporator coils. As is typical with split systems, the compressor/condenser cabinet was located at the home's exterior so that the heat collected inside the home could be released to the outside air. Evaporator coils designed to collect heat from the home interior were located inside a duct at the furnace and were not directly visible.*

Although (conditions permitting) the inspection of air-conditioning systems includes confirming cool air flow at registers, the General Home Inspection does not include confirmation of even temperature distribution throughout the home. Multiple-level homes with open staircases may experience significant temperature differences between upper and lower levels. Especially in homes with an open central stairwell, there will often be a noticeable temperature gradient, with the top floor being warmest and the lowest floor being coolest. This will be especially true in homes in which the cooling system was not designed and installed during original construction of the home. Ducts designed primarily for heating may not work well for cooling due to differences in air density between warm and cold air.

You may need to adjust some vents to force a greater flow of air into some areas during specific periods of the day to cool or heat specific areas or rooms to your satisfaction. The system must be adjusted to adapt to changing conditions. Adjusting the cooling system lies beyond the scope of the General Home Inspection. Under some circumstances, the cooling system may not cool upper floors to your satisfaction. You should ask the sellers if this has been a problem in the past. Methods exist to deal with inadequate air distribution and prior to the expiration of your Inspection Objection Deadline you may wish to consult with an HVAC contractor to gain an idea of options and costs.

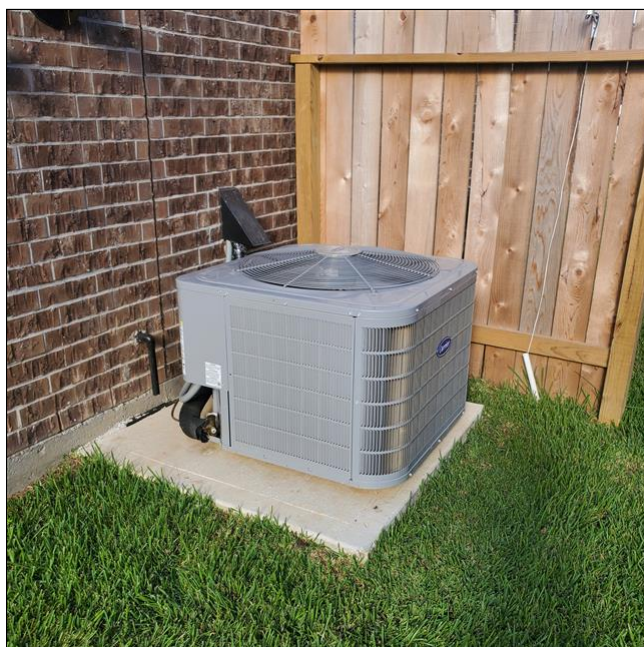

B. Item 1(Picture) Overview of AC unit.

(2) Temperature differentials were taken between the return and supply air in the home. A differential of

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

15-20 degrees is recommended. The differential that was found inside the home was approximately 18 degrees. It is the opinion of the inspector that the A/C is cooling as intended.



B. Item 2(Picture) 52 degree supply air.

C. Duct Systems, Chases, and Vents

Ductwork: Insulated

Filter Type: Disposable

Comments:

No defects were noted for the duct systems, chases, and vents during the inspection.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

IV. PLUMBING SYSTEM

Shutoff valves at the house and under the kitchen, wet bar, toilets, and bath sinks are not operated. It was not determined if they open and close properly. If the property is more than 10 years old, there is a strong possibility that some of these shutoff valves will not open or close properly and will have to be replaced. Washing machines are not operated during the inspection. No determination was made as to whether the washing machine drain line is operable. Overflow drains on sinks and tubs are not operated and it was not determined if they drain properly. Temperature and pressure (T&P) valve(s) on the water heater(s) are not operated.



Main water valve in the garage.



Water pressure was 66 psi (acceptable).

A. Plumbing Supply Distribution Systems and Fixtures

Location of water meter: Street

Location of main water supply valve: Garage

Static water pressure reading: 66 psi

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

Water Source: Public

Plumbing Water Distribution (inside home): PEX

Comments:

All plumbing fixtures were tested and no repairs are needed at this time.

B. Drains, Waste, and Vents

Plumbing Waste: PVC

Comments:

Note: It is not within the scope of this inspection to determine the condition of the under ground drain lines. If the property has trees in the yard or adjacent yards, it is strongly recommended that the services of a qualified licensed plumber be obtained to perform a hydro-static test on the drain lines and to use a camera to determine if there is any damage to the drain lines caused by items such as soil movement or tree root encroachment.

All drains functioned properly during the inspection.

C. Water Heating Equipment

Energy Sources: Gas

Water Heater #1 Capacity: Tankless

Water Heater #1 Manufacturer: Rinnai

Water Heater #1 Location: Garage

Comments:

Hot water for the home was supplied by a gas-fired tankless water heater installed at the home exterior. Tankless water heaters do not store water in a tank like conventional water heaters. When a hot water fixture is opened in the home, water flows into the water heater where it is heated by gas burners before flowing to the open hot water fixture. Tankless water heaters save energy by avoiding the stand-by losses associated with conventional water heaters which must constantly maintain water in a tank at a minimum temperature. Due to calcium build-up on components, tankless water heaters typically require service annually. Failure to service the water heater in a timely manner typically results in a reduced hot water flow rate.

No defects were noted for the installation and operation of the water heater during the inspection.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D



C. Item 1(Picture) Overview of water heater.

D. Hydro-Massage Therapy Equipment

Comments:

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

V. APPLIANCES

The home inspector shall observe and operate the basic functions of the following kitchen appliances: Permanently installed dishwasher, through its normal cycle; Range, cook top, and permanently installed oven; Trash compactor; Garbage disposal; Ventilation equipment or range hood; and Permanently installed microwave oven. The home inspector is not required to observe: Clocks, timers, self-cleaning oven function, or thermostats for calibration or automatic operation; Non built-in appliances; or Refrigeration units. The home inspector is not required to operate: Appliances in use; or Any appliance that is shut down or otherwise inoperable.

A. Dishwashers

Dishwasher Brand: Whirlpool

Comments:

The dishwasher operated as intended at the time of the inspection.

B. Food Waste Disposers

Disposer Brand: Badger

Comments:

The disposal was unplugged when the inspector arrived. The inspector plugged the disposal in to test the unit and the unit continued to run and would not shut off with the button on the countertop. This should be investigated and repaired.



B. Item 1(Picture) Button did not shut disposal off. Unit had to be unplugged.

C. Range Hood and Exhaust Systems

Exhaust/Range hood: Vented

Comments:

The micro-hood vent over the gas cooktop operated as intended and was routed to the exterior of the home as recommended with gas cooktops.

D. Ranges, Cooktops and Ovens

Range/Oven: Whirlpool

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D


Comments:

(1) All burners on the gas cooktop operated as intended at the time of the inspection.



D. Item 1(Picture) Gas burners working.

(2) The oven was tested at 350 degrees and bake. When the oven was finished preheating the thermometer placed in the oven read 360 degrees. This is not a defect. This is just information for the buyer.

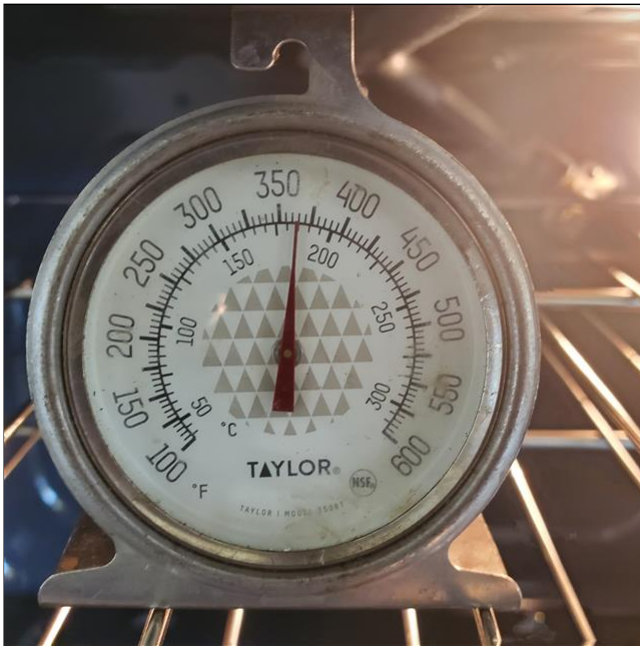

D. Item 2(Picture) Temperature test.

E. Microwave Ovens

Built in Microwave: Whirlpool

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

Comments:

The microwave operated as intended at the time of the inspection.

F. Mechanical Exhaust Vents and Bathroom Heaters

Comments:

All bathroom exhaust vents operated as intended at the time of the inspection.

G. Garage Door Operator(s)

Number of garage door openers: One

Comments:

The garage door opener and electric eyes operated as intended at the time of the inspection.

H. Dryer Exhaust Systems

Comments:

I. Other

Comments:

The doorbell operated as intended at the time of the inspection.

I = Inspected NI = Not Inspected NP = Not Present D = Deficient

I NI NP D

VI. OPTIONAL SYSTEMS

A. Landscape Irrigation (Sprinkler) Systems

Comments:

The inspection of the irrigation system includes testing all zones for operation, water coming to the surface where a spray head is not present, and for damaged spray heads. It was not determined if the property was fully covered by the irrigation system.

All zones were tested and no damages to the spray heads were observed.



A. Item 1(Picture) Photo of front yard zone running.

General Summary



JASE Home Inspections

**15529 Queen Elizabeth Ct.
Montgomery, Tx. 77316
281-906-7168**

Customer
Zane O'Keefe

Address
29119 Korsman Landing Dr.
Katy TX 77494

The following items or discoveries indicate that these systems or components **do not function as intended** or **adversely affects the habitability of the dwelling**; or **warrants further investigation by a specialist**, or **requires subsequent observation**. This summary shall not contain recommendations for routine upkeep of a system or component to keep it in proper functioning condition or recommendations to upgrade or enhance the function or efficiency of the home. This Summary is not the entire report. The complete report may include additional information of concern to the customer. It is recommended that the customer read the complete report.

I. STRUCTURAL SYSTEMS

E. Walls (Interior and Exterior)

Inspected, Deficient

The wood header is missing above a window at the left side of the home and there is a large gap in the wall. Repairs should be made immediately as wind driven rain will penetrate.

F. Ceilings and Floors

Inspected, Deficient

Damage to the grout was noted at the entry to the garage. Repairs are needed.

V. APPLIANCES

B. Food Waste Disposers

Inspected, Deficient

The disposal was unplugged when the inspector arrived. The inspector plugged the disposal in to test the unit and the unit continued to run and would not shut off with the button on the countertop. This should be investigated and repaired.

Home inspectors are not required to report on the following: Life expectancy of any component or system; The causes of the need for a repair; The methods, materials, and costs of corrections; The suitability of the property for any specialized use; Compliance or non-compliance with codes, ordinances, statutes, regulatory requirements or restrictions; The market value of the property or its marketability; The advisability or inadvisability of purchase of the property; Any component or system that was not observed; The presence or absence of pests such as wood damaging organisms, rodents, or insects; or Cosmetic items, underground items, or items not permanently installed. Home inspectors are not required to: Offer warranties or guarantees of any kind; Calculate the strength, adequacy, or efficiency of any system or component; Enter any area or perform any procedure that may damage the property or its components or be dangerous to the home inspector or other persons; Operate any system or component that is shut down or otherwise inoperable; Operate any system or component that does not respond to normal operating controls; Disturb insulation, move personal items, panels, furniture, equipment, plant life, soil, snow, ice, or debris that obstructs access or visibility; Determine the presence or absence of any suspected adverse environmental condition or hazardous substance, including but not limited to mold, toxins, carcinogens, noise, contaminants in the building or in soil, water, and air; Determine the effectiveness of any system installed to control or remove suspected hazardous substances; Predict future condition, including but not limited to failure of components; Since this report is provided for the specific benefit of the customer(s), secondary readers of this information should hire a licensed inspector to perform an inspection to meet their specific needs and to obtain current information concerning this property.

Prepared Using HomeGauge <http://www.HomeGauge.com> : Licensed To Jason Autrey



JASE Home Inspections

**15529 Queen Elizabeth Ct.
Montgomery, Tx. 77316
281-906-7168**

Report Attachments

ATTENTION: This inspection report is incomplete without reading the information included herein at these links/attachments. Note If you received a printed version of this page and did not receive a copy of the report through the internet please contact your inspector for a printed copy of the attachments.

[INSPECTION AGREEMENT](#)

[LIFE EXPECTANCY CHART](#)

[FOUNDATION LEVEL SURVEY](#)