

A CUSTOM HOME FOR:
RANGEL BUILDERS LLC

1610 NORTH TRAVIS
 LIBERTY TX, 77575



SHEET INDEX


ARCHITECTURAL / STRUCTURAL

- P1 ---- SITE PLAN
- P2 ---- SITE PLAN DETAILS
- A1 ---- FLOOR PLAN
- A2 ---- FLOOR PLAN (NO DIMS)
- A3 ---- FLOOR PLAN/ELECTRICAL NOTES
- A4 ---- ELECTRICAL PLAN
- A5 ---- EXTERIOR ELEVATIONS (FRONT/RIGHT)
- A6 ---- EXTERIOR ELEVATIONS (REAR/LEFT)
- S1 ---- FOUNDATION PLAN
- S2 ---- FOUNDATION DETAILS
- S3 ---- CEILING FRAMING PLAN
- S4 ---- CEILING FRAMING NOTES
- S5 ---- ROOF FRAMING PLAN
- S6 ---- BRACING & NAILING NOTES & DETAILS
- S7 ---- GENERAL NOTES & DETAILS

PROJECT INFORMATION

FLOOR LIVING AREA	1,534	S.F.
TOTAL LIVING AREA	1,534	S.F.
COVERED PORCH	233	S.F.
COVERED PATIO	77	S.F.
2-CAR GARAGE	419	S.F.
TOTAL COVERED AREA	2,263	S.F.

VICINITY MAP

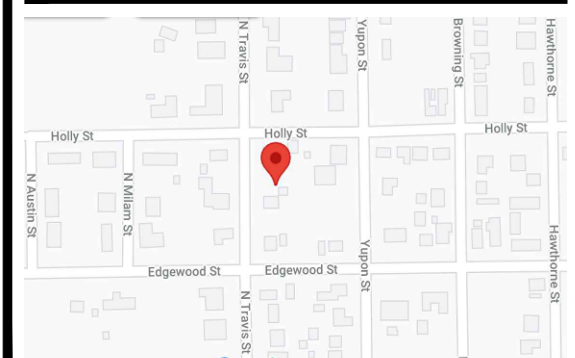


ISSUE DATE: 03-01-2022


DESIGNER

HOUSTON PLANS & PERMITS, LLC
 1235 N. LOOP WEST, SUITE 1104
 HOUSTON TX, 77008
 PLANSANDPERMITS.NET
 (281) 372-1555


02752-02

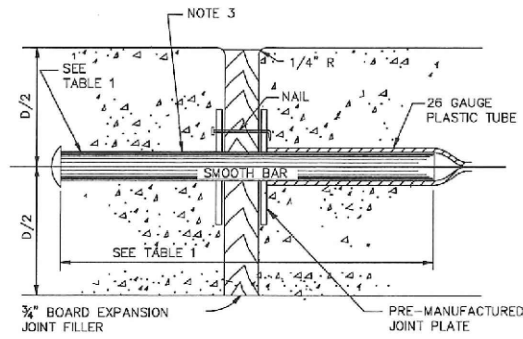

SECTION DOWEL TYPE EXPANSION JOINT N.T.S.



PLAN - JOINT PLATE N.T.S.




ELEVATION - JOINT PLATE N.T.S.


NOTES:

1. STEEL TO MEET ASTM STANDARD SPECIFICATIONS FOR CONCRETE REINFORCING BARS.
2. EXPANSION JOINT TO BE PLACED AT THE END OF EACH CURB RADIUS AND SPACED AT A MAXIMUM DISTANCE OF 3 FEET MAXIMUM SPACING FOR CONTROL JOINTS SHALL BE 5 FEET.
3. CENTER DOWEL HORIZONTALLY ON JOINT.
4. CENTER DOWEL VERTICALLY IN CONCRETE AS NEEDED TO MAINTAIN A 2 INCH MINIMUM COVER.


SIDEWALK EXPANSION AND CONSTRUCTION JOINT DETAILS NTS

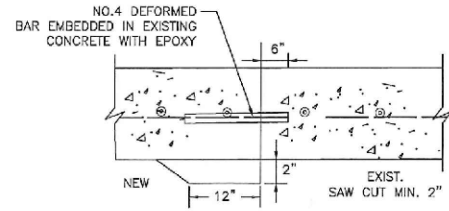

SECTION SIDEWALK TO EXISTING SIDEWALK N.T.S.

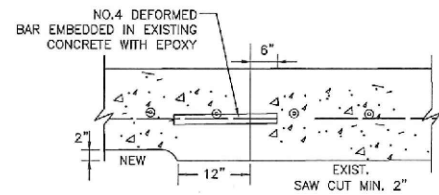

SECTION SIDEWALK TO EXISTING DRIVEWAY N.T.S.

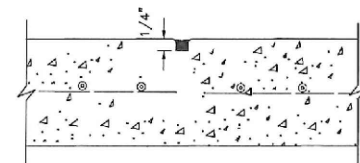


SECTION CONTROL JOINT N.T.S.


TABLE 1

PAVEMENT THICKNESS (IN)	DOWEL SIZES AND SPACINGS		
	DIAMETER (IN)	LENGTH (IN)	SPACING (IN)
4 1/2	1/2	18	12
5	1/2	18	12
6	3/4	18	12
7	1	18	12


02754-01A

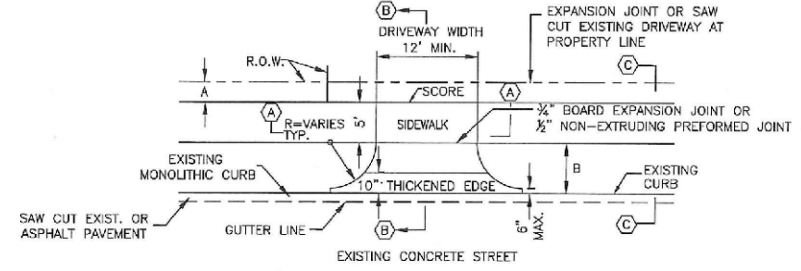


PLAN VIEW - DRIVEWAY

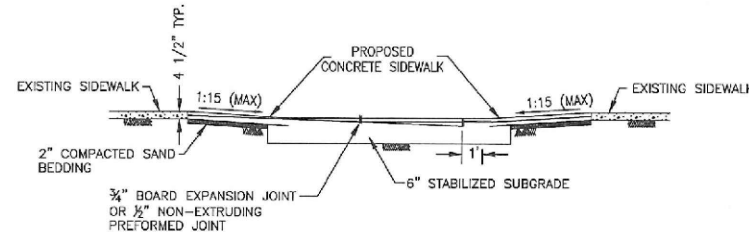

SECTION (A) PROPOSED SIDEWALK THROUGH DRIVEWAY WITH EXCESSIVE GRADES N.T.S.

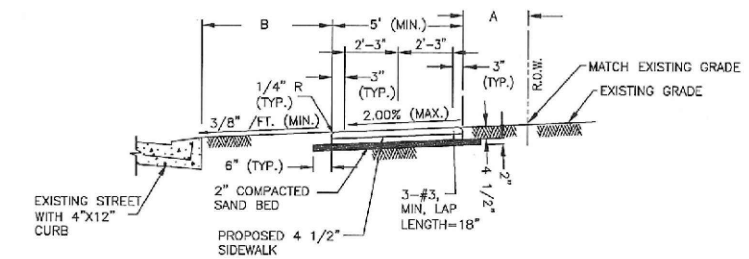

SECTION (C) TYPICAL SIDEWALKS SECTION N.T.S.

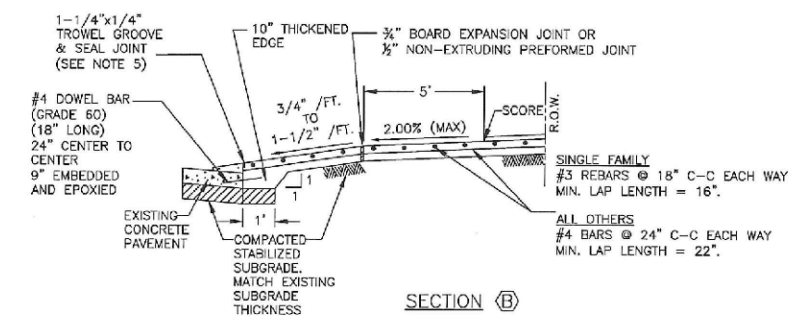

SECTION (B) TYPICAL DRIVEWAY SECTION N.T.S.

DRIVEWAY / LOCAL RESIDENTIAL STREETS NTS

NOTES:

1. IF AVAILABLE ROW IS NOT SUFFICIENT TO ACCOMMODATE SIDEWALK WIDTH (SW) ACCORDING TO IDM REQUIREMENT, ENGINEER SHALL OBTAIN A VARIANCE FROM THE CITY ENGINEER.
2. DRIVEWAYS SHALL BE 6" THICK FOR SINGLE FAMILY.
3. DRIVEWAYS AND SIDEWALKS SHALL BE CONSTRUCTED WITH PORTLAND CEMENT CONCRETE AND INCLUDE 5 1/2 SACKS OF CEMENT PER CUBIC YARD OF CONCRETE.
4. THE OUTER DOWEL BARS ARE TO BE LOCATED 12" FROM END OF PROPOSED EDGE OF DRIVEWAY RETURN. EXTEND DOWEL 3" INCHES INTO PROPOSED DRIVEWAY AND BEND REMAINING BAR TO EXTEND TO RADIUS RETURN BOTH SIDES.
5. TROWEL GROOVE SEALANT SHALL BE LOW MODULUS SILICONE OR POLYURETHANE SEALANT.
6. EXPANSION & CONSTRUCTION JOINTS ALONG SIDEWALK SHALL BE ACCORDING TO DRAWING No. 02752-02.
7. REFER CHAPTER 17 DESIGN REQUIREMENTS FOR A AND B.
8. CEMENT STABILIZED SAND 1.5 SACKS OF CEMENT PER TON OF DRY SAND.
9. ALL RAMPS AND SIDEWALKS/WALKWAYS SHALL BE CONSTRUCTED IN ACCORDANCE WITH AGENCY STANDARD DETAILS, TEXAS ACCESSIBILITY STANDARDS (TAS) AND AMERICANS WITH DISABILITIES ACT (ADA) REQUIREMENTS, IF THERE IS A CONFLICT IN THE REQUIREMENTS, THE STRICTEST REQUIREMENTS SHALL GOVERN.
10. CURB RAMPS THAT ARE STEEPER THAN A 1:15 MAX SLOPE WILL NOT BE ACCEPTED BY THE CITY OF HOUSTON

CITY OF HOUSTON
HOUSTON PUBLIC WORKS


STREET PAVING AND SIDEWALK
02752-02 THROUGH 02754-01A

APPROVED BY: [Signature] CITY ENGINEER
APPROVED BY: [Signature] DEPUTY DIRECTOR

APPROVED BY: [Signature] DIRECTOR OF HOUSTON PUBLIC WORKS

EFFECTIVE DATE: JUL-01-2020
FOR CITY OF HOUSTON USE ONLY

SHEET NO.

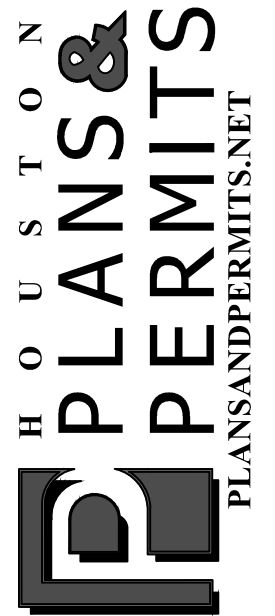

NO.	DATE	DESCRIPTION	BY	REV.

PROJECT: RANGEL BUILDERS LLC
ADDRESS: 1610 NORTH TRAVIS
LIBERTY, TX 77575
DESIGNER ADDRESS: 1235 N. Loop West Suite #1104 Houston TX, 77008
information@plansandpermits.net
P: 281.372.1555



SHEET NO.
P2


BY	REV.	DESCRIPTION	DATE

DRAWN BY: NR
 CHECKED BY: AR
 DATE DRAWN: 02-09-22

PROJECT: **RANGEL BUILDERS LLC**
 ADDRESS: **1610 NORTH TRAVIS**
LIBERTY, TX 77575
 DESIGNER ADDRESS:
 1235 N. Loop West Suite #1104 Houston TX, 77008
 information@plansandpermits.net
 P: 281.372.1555



SHEET NO.
A2

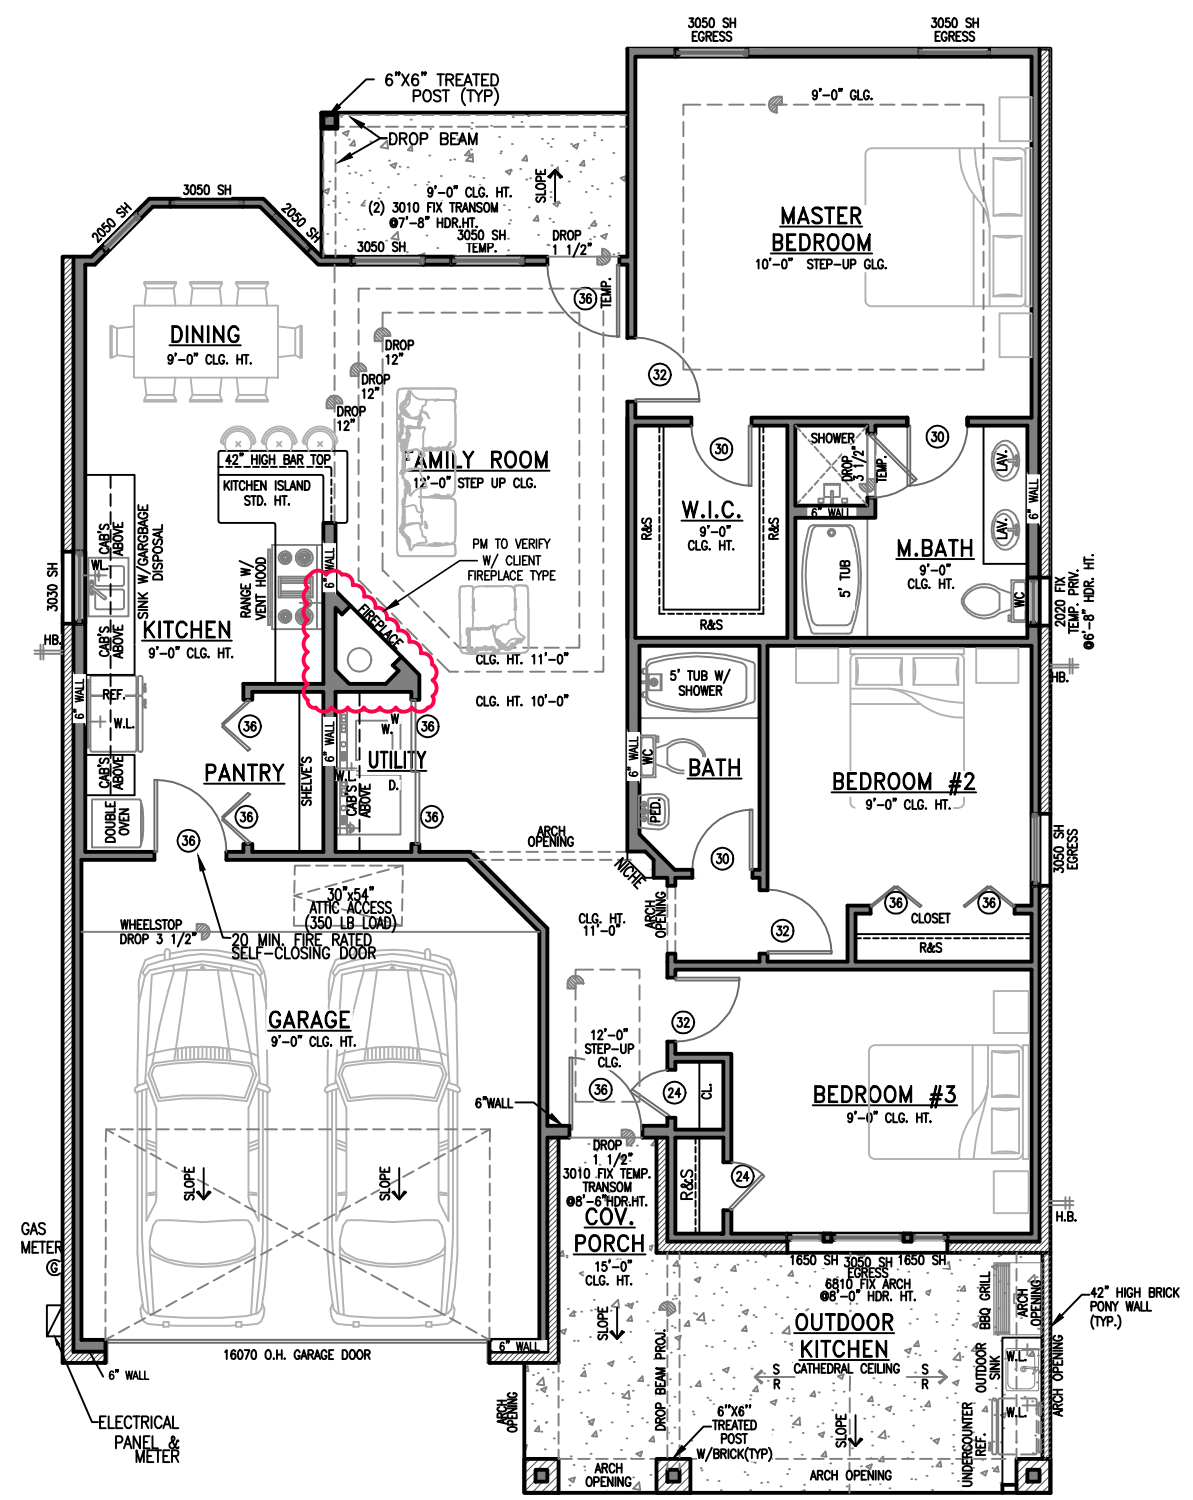

AREA CALCULATION:		
FLOOR LIVING AREA	1,534	S.F.
TOTAL LIVING AREA	1,534	S.F.
COVERED PORCH	233	S.F.
COVERED PATIO	77	S.F.
2-CAR GARAGE	419	S.F.
TOTAL COVERED AREA	2,263	S.F.

FLOOR PLAN NOTES
 SEE NOTES ON SHEET "A3"

TO THE BEST OF MY KNOWLEDGE, THESE PLANS ARE DRAWN TO COMPLY WITH OWNERS'S SPECIFICATIONS. CONTRACTOR AND/OR OWNER SHALL VERIFY ALL DIMENSIONS, DETAILS, AND SPECIFICATIONS BEFORE CONSTRUCTION. DESIGNER WILL NOT BE LIABLE FOR HUMAN ERROR AFTER CONSTRUCTION IS STARTED. THE INFORMATION, SPECIFICATIONS, AND DESIGNS APPEARING IN THIS SHEET ARE PROPERTY OF HOUSTON PLANS AND PERMITS, LLC. ANY UNAUTHORIZED USE OR DUPLICATION IN WHOLE OR IN PART IS STRICTLY PROHIBITED.

FLOOR PLAN |
 (NO DIMS) | SCALE: 1/8" = 1'-0"

IRC R309.2. THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE AND IT'S ATTIC AREA BY NOT LESS THAN 1/2" GYPSUM BOARD ON THE GARAGE SIDE. GARAGES BENEATH THE HABITABLE ROOMS SHALL BE SEPARATED FROM ALL HABITABLE ROOMS ABOVE (CEILING OF GARAGE) BY NOT LESS THAN 5/8" TYPE X GYPSUM BOARD.

OPENINGS BETWEEN THE GARAGE AND RESIDENCE SHALL BE EQUIPPED WITH SOLID WOOD DOORS NOT LESS THAN 1 3/8" INCH (35MM) IN THICKNESS, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" INCHES (35MM) THICK, OR 20-MINUTE FIRE-RATED DOORS ALL OF WHICH SHALL BE SELF CLOSING.

GENERAL NOTES:

1. ALL WORK TO BE DONE AS PER CODE AND REGULATIONS.
2. WATER RESIST GYP. BOARD (FULL HGT.), AT SHOWER, TUB, AND WALLS SUBJECT TO WATER SPLASH.
3. TUB AND SHOWER, IF NOT FIBER GLASS, SHALL BE TILED TO 70" ABOVE DRAIN INLET.
4. GLAZING IN SHOWER, TUB ENCLOSURE, & DOOR, SHALL BE IMPACT RESISTANT (TEMPERED).
5. PROVIDE ACCESS PANELS AT PLUMBING WALLS, ESPECIALLY TUB WALLS.
6. FOR INSTALLATION OF AHU SEE CONTRACTOR.
7. ALL EXHAUST FANS MUST BE VENTED TO THE OUTSIDE.
8. PROVIDE G.F.I. WHERE SHOWN AS PER NATIONAL ELECTRICAL CODE.
9. GAS INSTALLATIONS AND APPLIANCES ARE TO BE CONSISTENT WITH APPLICABLE CODES AND MANUFACTURER'S SPECIFICATIONS.
10. FIRE BOX IS TO BE INSTALLED AS PER 2012 I.F.C. STANDARD AND MANUFACTURER'S SPECIFICATIONS ARE TO BE POSTED AT THE JOB SITE.
11. ALL EXTERIOR FINISHES SHALL BE WATER RESISTANT.

NOTES:

1. ALL FLOOR CEILINGS 9'-0" HIGH (U.N.O.)
2. SMOKE DETECTORS SHALL BE HARD-WIRED, INTER-CONNECTED, WITH BATTERY BACK UP AS PER THE IRC R313.3
3. PROVIDE SAFETY GLAZING IN ALL SPECIFIC HAZARDOUS LOCATIONS IN ACCORDANCE WITH THE REQUIREMENTS OF IRC SECTION R308.
4. PROVIDE PLYWOOD PAD IN ATTIC FOR HVAC UNIT(S) W/REQUIRED ELECT. MECH & PLUMB.

NOTES:

ALL WALLS TO BE 2"x4" (U.N.O.) WOOD STUDS @ 16" O.C. PROVIDE FIRE STOPS AS REQUIRED INTERIOR WALLS TO HAVE 1/2" GYP. BD. PTD ON BOTH SIDES. PROVIDE GREEN BD @ ALL WET AREAS.

VERIFY ALL DIMENSIONS, DROPS, OFFSETS, BRICK LEDGES, INSERTS AND OPENINGS WITH OWNER / GENERAL CONTRACTOR

ESCAPE/RESCUE WINDOWS FROM SLEEPING AREAS SHALL HAVE MIN. 5.7 S.F. CLEAR NET OPENING. AND MIN. CLEAR OPENING HT. OF 24" AND MIN. CLEAR OPENING WIDTH OF 20". FINISHED SILL HT. SHALL BE MAX. OF 44" ABOVE FLOOR.

THE ATTIC ROUGH OPENING SHALL BE 30"x54" AND THE STAIR LOAD CAPACITY SHALL BE AN MINIMUM OF 350 POUNDS. ATTIC ACCESS STAIRWAY SHOULD HAVE A MINIMUM OF 22" WIDTH.

FLOOR PLAN NOTES

SCALE: N.T.S.

AREA CALCULATION:		
FLOOR LIVING AREA	1,534	S.F.
TOTAL LIVING AREA	1,534	S.F.
COVERED PORCH	233	S.F.
COVERED PATIO	77	S.F.
2-CAR GARAGE	419	S.F.
TOTAL COVERED AREA	2,263	S.F.

TO THE BEST OF MY KNOWLEDGE, THESE PLANS ARE DRAWN TO COMPLY WITH OWNERS'S SPECIFICATIONS. CONTRACTOR AND/OR OWNER SHALL VERIFY ALL DIMENSIONS, DETAILS, AND SPECIFICATIONS BEFORE CONSTRUCTION. DESIGNER WILL NOT BE LIABLE FOR HUMAN ERROR AFTER CONSTRUCTION IS STARTED. THE INFORMATION, SPECIFICATIONS, AND DESIGNS APPEARING IN THIS SHEET ARE PROPERTY OF HOUSTON PLANS AND PERMITS, LLC. ANY UNAUTHORIZED USE OR DUPLICATION IN WHOLE OR IN PART IS STRICTLY PROHIBITED.

NOTE:

GARAGE ATTIC ACCESS-R302.6. PULL DOWN STAIRWAYS IN A GARAGE CEILING SHALL BE PROVIDED WITH A 3/8" FIRE RETARDANT PANEL OR 16 GAUGE SHEET METAL.

CARBON MONOXIDE ALARM SHALL BE INSTALLED OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS IN DWELLING UNITS WITHIN WHICH FUEL-FIRED APPLIANCES ARE INSTALLED AND IN DWELLING UNITS THAT HAVE ATTACHED GARAGES R315.1

SMOKE DETECTORS SHALL BE HARD-WIRED, INTER-CONNECTED, WITH BATTERY BACK UP AS PER THE IRC R313.3

ELECTRICAL GENERAL NOTES

1. ELECTRICAL INSTALLATION TO BE IN ACCORDANCE WITH THE 2020 (NEC) STARTED NOV 1, 2021. NFPA-70.
2. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR OBTAINING ELECTRICAL PERMITS AND INSPECTION.
3. CONVENIENCE RECEPTACLE - MOUNT AT 12" A.F.F.
4. MICROWAVE - OVEN TO HAVE SEPARATE 20 AMP RECEPTACLE AT 78" A.F.F .
5. BATHROOM RECEPTACLE - GFI MOUNT 40" A.F.F.
6. RECEPTACLES IN THE GARAGE TO BE GFI UNLESS OTHERWISE.
7. EXTERIOR RECEPTACLES TO BE GFI AND WEATHER PROTECTED.
8. WASHER - DRYER TO HAVE SEPARATE 20 AMP DUPLEX RECEPTACLE AT 44" A.F.F.
9. TELEPHONE OUTLETS - PROVIDE BOX (MOUNT AT 12" A.F.F. UNLESS NOTED OTHERWISE). COVER PLATE 4/0 WIRE TERMINATE NEAR PANEL.
10. KITCHEN COUNTER AND REFRIGERATOR RECEPTACLES AND APPLIANCE SWITCHES MOUNT AT 44" A.F.F.
11. SWITCHED - MOUNT AT 54" A.F.F.
12. ATTIC LIGHT SWITCH MOUNT AT 84" A.F.F.

ELECTRICAL NOTES:

1. CONTRACTOR SHALL COMPLY W/ ALL LOCAL, STATE AND FEDERAL CODES REQUIRED. AND REFER TO OWNER FOR EXACT LOCATION OF LIGHT FIXTURES AND CEILING DEVICES.
2. ALL CONDUCTORS SHALL BE NO. 12 AWG SOLID COOPER (THW) IN 3/4" CONDUIT WHERE REQUIRED
3. CONTRACTOR SHALL COORDINATE W/ EXISTING CONDITIONS AT THE SITE AND FURNISH PROPER CONNECTIONS AS REQUIRED.
4. ALL CONDUITS REGARDLESS OF TYPES WHICH CONTAIN LINE VOLTAGE CONDUCTORS SHALL HAVE A GROUND CONDUCTOR SIZED IN ACCORDANCE WITH 2020 (NEC) STARTED NOV 1, 2021

LEGEND	
	110 VOLT RECEPTACLE
	WATERPROOF RECEPTACLE
	110 VOLT IN CLG.
	110 VOLT W/ GROUND FAULT INTERRUPTOR
	110 VOLT IN FLOOR
	220 VOLT RECEPTACLE
	TELEVISION ANTENNA
	GAS OUTLET
	HOSE BIB
	TELEPHONE OUTLET
	SINGLE POLE SWITCH
	THREE WAY SWITCH
	FOUR WAY SWITCH
	DIMMER SWITCH
	PUSH BUTTON
	SMOKE DETECTOR
	CARBON MONOXIDE ALARM
	THERMOSTAT
	CHIMES
	CEILING MOUNTED LIGHT FIXTURE
	HANGING LIGHT
	RECESSED CAN LIGHT
	WATERPROOF RECESSED CAN LIGHT
	RECESSED EYEBALL SPOT LIGHT
	WALL MOUNTED LIGHT FIXTURE
	PORCELAIN FIXTURE W/ PULL CORD
	FLOOD LIGHTS
	EXHAUST FAN
	EXHAUST FAN W/ LIGHT
	EXHAUST FAN W/ HEAT LAMP
	EXHAUST FAN W/ HEAT LAMP & LT.
	CEILING FAN
	CEILING FAN W/ LIGHT
	CEILING LIGHT W/ FUTURE FAN
	2'X4' FLUORESCENT LIGHT
	UNDER COUNTER LIGHT

ELECTRICAL PLAN NOTES

SCALE: N.T.S.

DATE	DESCRIPTION	BY	REV.	CHECKED BY: AR	DATE DRAWN: 02-09-22

PROJECT: **RANGEL BUILDERS LLC**
 ADDRESS: **1610 NORTH TRAVIS LIBERTY, TX 77575**
 DESIGNER ADDRESS: **1235 N. Loop West Suite #1104 Houston TX, 77008 information@plansandpermits.net P: 281.372.1555**



SHEET NO.

A3

GENERAL FOUNDATION NOTES

1. GENERAL NOTES:
 - A. THESE GENERAL NOTES SHALL APPLY TO THE STRUCTURAL DRAWINGS, UNLESS OTHERWISE NOTED.
 - B. UNLESS OTHERWISE INDICATED, ALL DETAILS OF DESIGN, WORKMANSHIP AND MATERIALS SHALL CONFORM TO THE LATEST EDITION OF THE INTERNATIONAL RESIDENTIAL CODE (IRC - 2012), WITH CITY OF HOUSTON AMENDMENTS, SOUTHERN BUILDING CODE, TEXAS WIND STORM BUILDING STORM CODE, TEXAS WIND STORM CONSTRUCTION GUIDELINES AND LOCAL BUILDING CODES.
2. FOUNDATION NOTES:
 - A. SEE FOUNDATION PLAN FOR LOCATIONS OF BEAMS, BELLBOTTOMS, DROPS, ETC. THE CONTRACTOR SHALL VERIFY OVERALL DIMENSIONS AND PLUMBING LOCATION PRIOR TO POURING CONCRETE.
 - B. ALL FOUNDATION EXCAVATION TO BE CARRIED TO UNDISTURBED MATERIAL OR PLACED IN APPROVED ENGINEERED FILL. EXCAVATIONS SHALL BE FREE OF LOOSE MATERIAL AND WATER.
 - C. OVER EXCAVATION OF MATERIALS SHALL BE BACKFILLED WITH CONCRETE.
 - D. ALL BACKFILL AROUND FOOTINGS, BEHIND WALLS AND UNDER SLABS SHALL BE COMPACTED. SEE SOIL REPORT FOR SITE PREPARATION SPECIFICATIONS, IF AVAILABLE.
 - E. BACKFILLS AGAINST FOUNDATION WALLS WILL NOT BE PERMITTED UNTIL THE WALL HAS REACHED 28 DAY STRENGTH AND ALL SUPPORTING STRUCTURE IS IN PLACE.
 - F. STEP FOOTING AT A RATIO OF ONE VERTICAL TO TWO HORIZONTAL, WITH A MAXIMUM VERTICAL STEP OF 2'-0" UNLESS NOTED OTHERWISE.
 - G. WATERPROOFING OF FOUNDATIONS AND RETAINING WALLS SHALL BE THE RESPONSIBILITY OF THE OWNER OR CONTRACTOR AND IS NOT THE RESPONSIBILITY OF THE ENGINEER.
 - H. ANY UNUSAL SITE CONDITIONS (e.g. LOOSE FILL, SUBSURFACE WATER, ETC.) SHALL BE REPORTED TO THE ENGINEER.
 - I. CONCRETE AND REINFORCING FOR DRILLED FOOTINGS SHALL BE PLACED IMMEDIATELY AFTER EXCAVATION.
 - J. ALL PIPES THROUGH EXTERIOR GRADE BEAMS SHALL BE SLEEVED. ALL PIPES SHALL BE LOCATED AT MID-DEPTH OF GRADE BEAMS. SIZE OF SLEEVES SHALL NOT EXCEED 1/3 OVERALL DEPTH OF GRADE BEAM. SPACING OF SLEEVES SHALL NOT BE CLOSER THAN 5 DIAMETERS ON THE CENTER.
3. REINFORCING CONCRETE:
 - A. REINFORCING CONCRETE SHALL CONFORM TO APPLICABLE REQUIREMENTS OF THE IRC-2012 AND A.C.I. STANDARD 318.
 - B. ALL CONCRETE USED IN FOUNDATIONS AND SLABS ON GRADE SHALL HAVE A 28 DAY COMPRESSIVE STRENGTH OF NOT LESS THAN 3000 psi.
 - C. THE MAXIMUM SLUMP SHALL NOT EXCEED 5 INCHES.
 - D. PROVIDE # 3's @ 16" ON CENTER EACH WAY IN ALL SLABS ON GRADE, PLACED 1 1/2" DOWN FROM TOP OF SLAB, UNLESS OTHERWISE NOTED.
 - E. PROVIDE WELDED WIRE FABRIC IN FLAT SHEETS, NOT IN ROLLS.
 - F. PROVIDE CONTROL JOINTS IN ALL EXPOSED SLABS ON GRADE. THE MAXIMUM SPACING OF CONTROL JOINTS SHALL BE 20'-0" O.C., UNLESS OTHERWISE NOTED.
 - G. POUR SLAB IN STRIP POURS, NOT IN CHECKERBOARD PATTERN.
 - H. PROVIDE VERTICAL CONTROL JOINTS IN ALL CONCRETE WALLS. THE MAXIMUM SPACING OF CONTROL JOINTS SHALL BE 20'-0", UNLESS OTHERWISE NOTED. CUT ALTERNATE HORIZONTAL REINFORCING BARS, EACH FACE.
 - I. ADDITIVES CONTAINING CALCIUM CHLORIDE SHALL NOT BE USED.
4. REINFORCING STEEL:
 - A. ALL REINFORCING STEEL SHALL CONFORM TO ASTM A615 GRADE 60 UNLESS OTHERWISE INDICATED, EXCEPT #3 OR SMALLER MAY BE ASTM A615 GRADE 40.
 - B. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A185.
 - C. ALL REINFORCING STEEL SHALL BE ACCURATELY LOCATED AND ADEQUATELY SECURED IN POSITION BEFORE AND DURING PLACEMENT OF CONCRETE.
 - D. ALL DETAILS OF FABRICATION AND INSTALLATION OF REINFORCING STEEL SHALL BE IN ACCORDANCE WITH THE ACI MANUAL OF STANDARD PRACTICE.
 - E. LAP REINFORCING BAR SPLICES 40 BAR DIAMETERS, UNLESS OTHERWISE NOTED. (SPLICE REINFORCING STEEL 36" WHEN ALL BARS ARE SPLICED AT ANY ONE POINT).
 - F. BEND ALL HORIZONTAL BEAM AND WALL BARS 40 BAR DIAMETERS AROUND ALL CORNERS, OR 40 BAR DIAMETERS, SPLICE CORNER BARS, UNLESS OTHERWISE NOTED.
 - G. PROVIDE VERTICAL AND HORIZONTAL REINFORCING BARS IN CONCRETE AND MASONRY WALLS TO CONFORM TO THE MINIMUM PROVISIONS OF ACI 318, SECTION 14.3, UNLESS OTHERWISE NOTED.
 - H. PROVIDE THE FOLLOWING MINIMUM CONCRETE COVER OVER REINFORCING STEEL:
 - CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH . . . 3"
 - CONCRETE EXPOSED TO EARTH OR WEATHER . . . 1 1/2"
 - CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH EARTH . . . 3/4"

FOR SI: 1 POUND PER SQUARE FOOT = 0.0479 KPA.
 a. WHEN SOIL TESTS ARE REQUIRED BY SECTION R401.4, THE ALLOWABLE BEARING CAPACITIES OF THE SOIL SHALL BE PART OF THE RECOMMENDATIONS.
 b. WHERE THE BUILDING OFFICIAL DETERMINES THAT IN-PLACE SOILS WITH AN ALLOWABLE BEARING CAPACITY OF LESS THAN 1,500 PSF ARE LIKELY TO BE PRESENT AT THE SITE, THE ALLOWABLE BEARING CAPACITY SHALL BE DETERMINED BY A SOILS INVESTIGATION.

STRUCTURAL FILL MATERIALS SHOULD CONSIST OF A CLAYEY SAND OR INACTIVE LEAN CLAY FREE OF ORGANIC OR OTHER DELETERIOUS MATERIALS. HAVE A LIQUID LIMIT NOT GREATER THAN 35, AND PLASTICITY INDEX BETWEEN 6 AND 20. STRUCTURAL FILL SHOULD BE PLACED IN MAXIMUM LOOSE LIFTS OF 8 INCHES AND SHOULD BE COMPACTED TO AT LEAST 95% OF MAXIMUM DRY DENSITY AT MOISTURE CONTENT WITHIN ± 3% OF THE OPTIMUM MOISTURE CONTENT AS DETERMINED BY ASTM D-698.

NOTE:

TO THE BEST OF MY KNOWLEDGE, THE SOIL IS ADEQUATE FOR THE SIZE AND LOADS OF THE PROPOSED HOUSE. THE FOUNDATION IF CONSTRUCTED AS SHOWN IN THE PERMIT. DRAWING WOULD BE IN CONFORMANCE WITH THE SPECIFICATIONS AND THE APPLICABLE WORKMANSHIP PROVISION OF THE IRC-2012 BUILDING CODE.

NOTES:


1. SEE ARCHITECTURAL DWGS. FOR PLUMBING, RECESSES UTILITIES ETC.
2. COORDINATE ALL DIMENSIONS (IF REQUIRED) WITH ARCHITECTURAL DRAWINGS.
3. CONTRACTOR PLEASE VERIFY ALL WALK DOOR AND O.H. O.H. DOOR LOCATIONS.
4. SEE STRUCTURAL DWGS FOR ANCHORS, ETC.
5. VERIFY FOUNDATION SLOPES WHERE REQUIRED.

NOTE:

F.F. ELEV. NOT LESS THAN 12" ABOVE NEAREST SANITARY SEWER MANHOLE RIM, OR 4" ABOVE THE CROWN OF STREET, EXCEPT ON FLOOD ZONE TO BE VERIFIED WITH APPLICABLE CODE REQUIREMENTS FOR FINISH FLOOR ELEVATION.

FOUNDATION PLAN NOTES

SEE NOTES ON SHEET "S2"

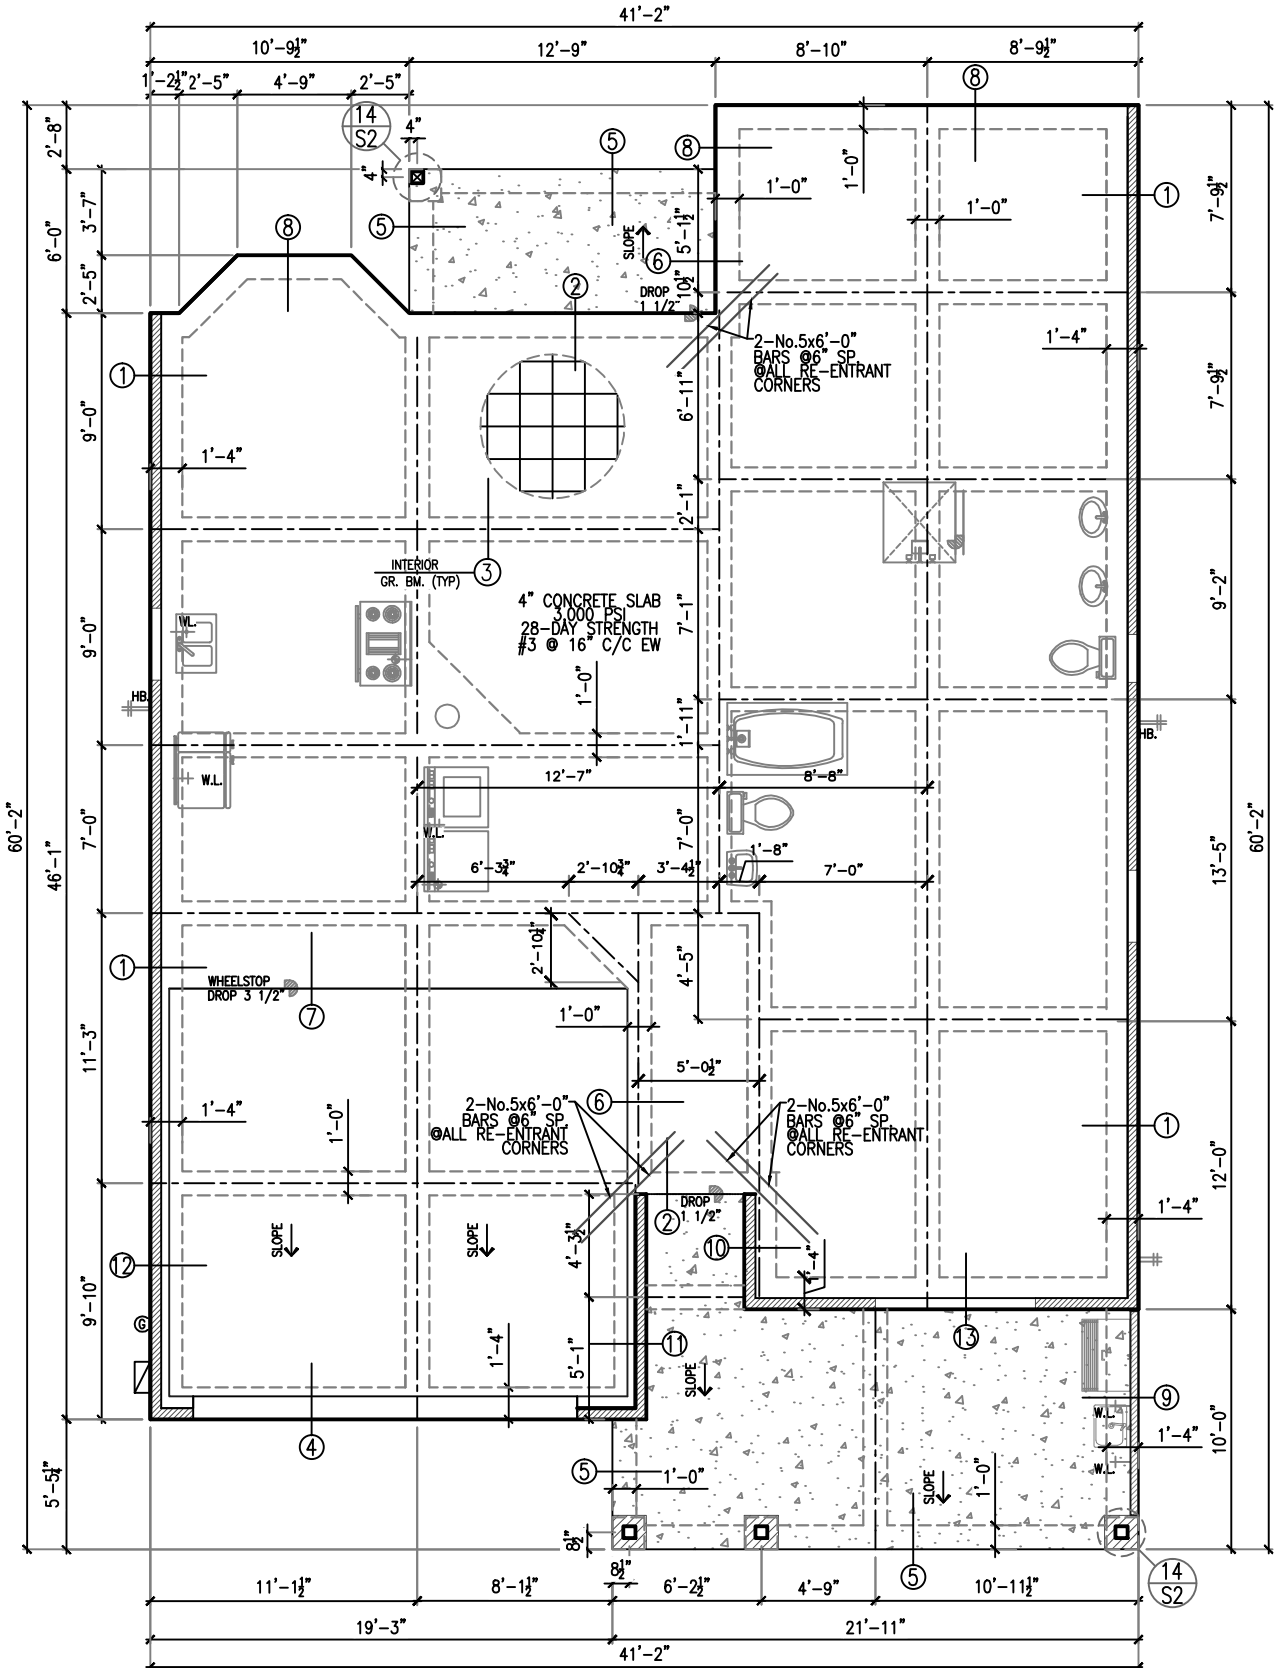

NOTE:
 CONTRACTOR TO VERIFY FOUNDATION FOOTPRINT WITH ARCHITECTURAL PLAN PRIOR TO CONSTRUCTION

TABLE R401.41 PRESUMPTIVE LOAD-BEARING VALUES OF FOUNDATION MATERIAL

CLASS OF MATERIAL	LOAD-BEARING PRESSURE
CRYSTALLINE BEDROCK	12,000
SEDIMENTARY AND FOLIATED ROCK	4,000
SANDY GRAVEL AND/OR GRAVEL (GW AND GP)	3,000
SAND, SILTY SAND, CLAYEY SAND, SILTY GRAVEL, CLAYEY GRAVEL (SW, SP, SM, SC, GM, AND GC)	2,000
CLAY, SANDY CLAY, SILTY CLAY, CLAYEY SILT, SILT AND SANDY SILT (CL, ML, MH, AND CH)	1,500 ^b

FOUNDATION PLAN

SCALE: 1/8" = 1'-0"


PROJECT: **RANGEL BUILDERS LLC**

ADDRESS: **1610 NORTH TRAVIS**


LIBERTY, TX 77575

SHEET NO.


S1

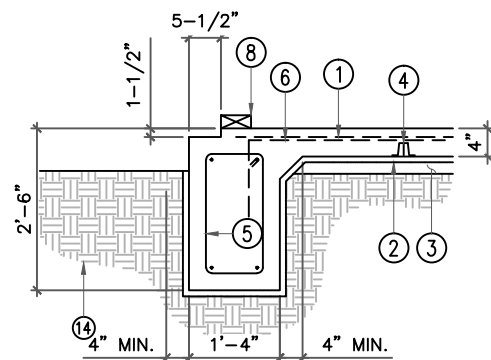


1 FOUNDATION DETAIL
NO SCALE

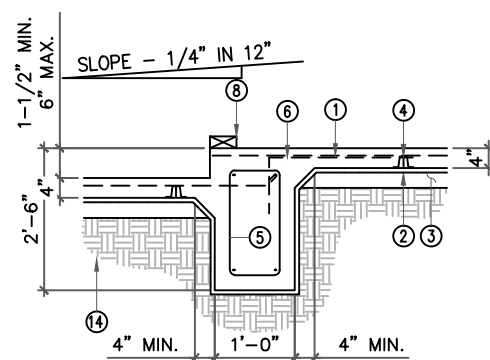


2 FOUNDATION DETAIL
NO SCALE

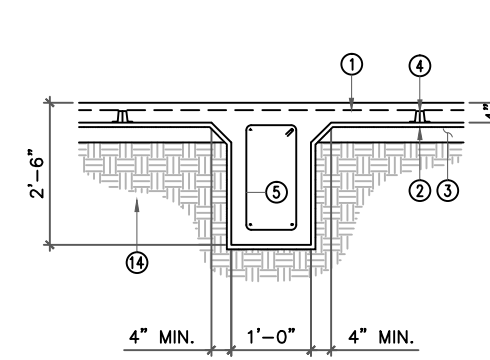


3 FOUNDATION DETAIL
NO SCALE

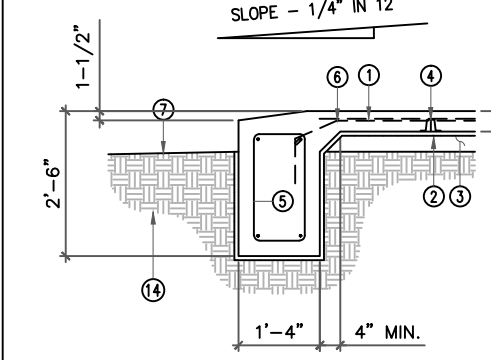


4 FOUNDATION DETAIL
NO SCALE

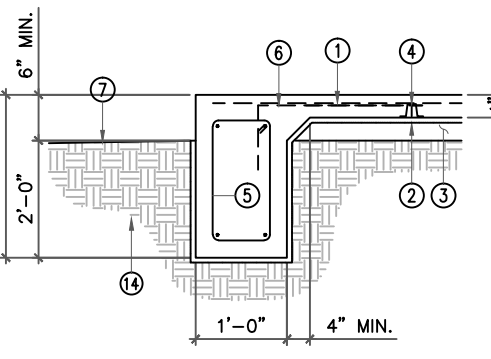


5 FOUNDATION DETAIL
NO SCALE

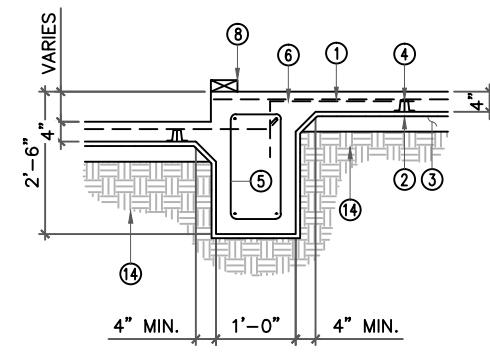


6 FOUNDATION DETAIL
NO SCALE

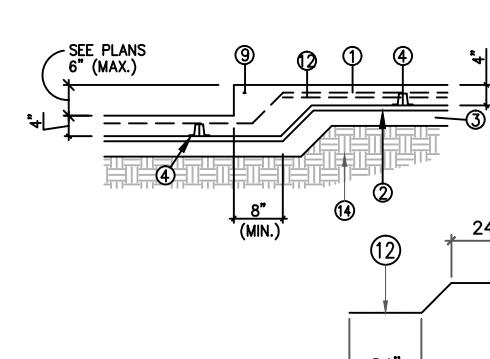


7 FOUNDATION DETAIL
NO SCALE

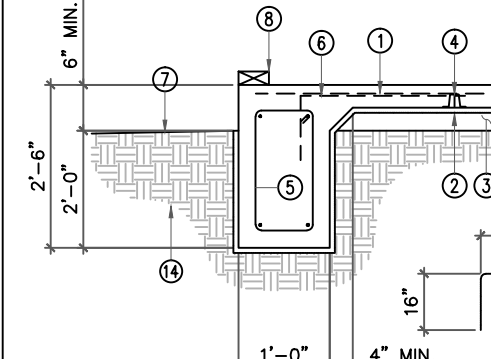


8 FOUNDATION DETAIL
NO SCALE

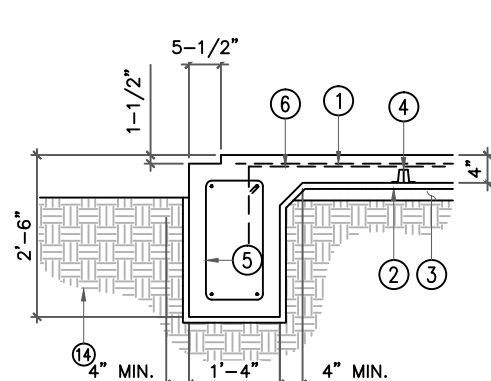


9 FOUNDATION DETAIL
NO SCALE

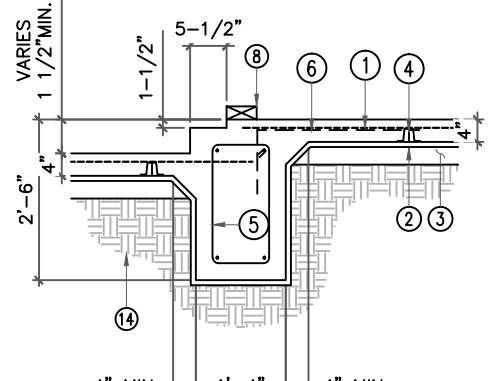


10 FOUNDATION DETAIL
NO SCALE

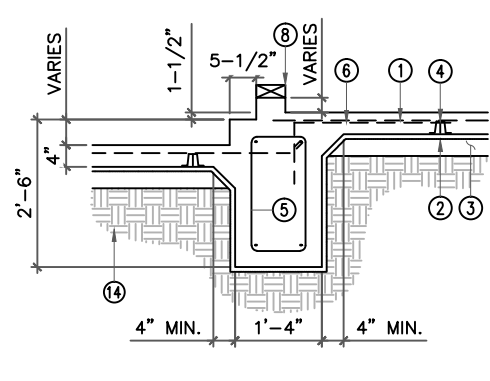


11 FOUNDATION DETAIL
NO SCALE

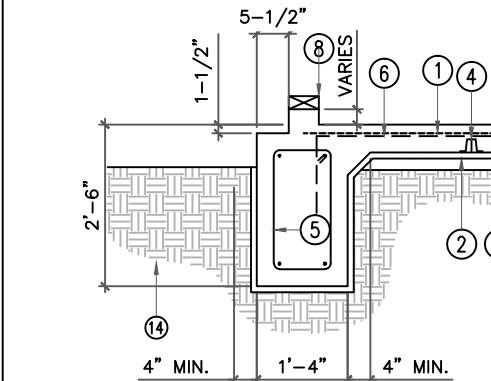

12 FOUNDATION DETAIL
NO SCALE

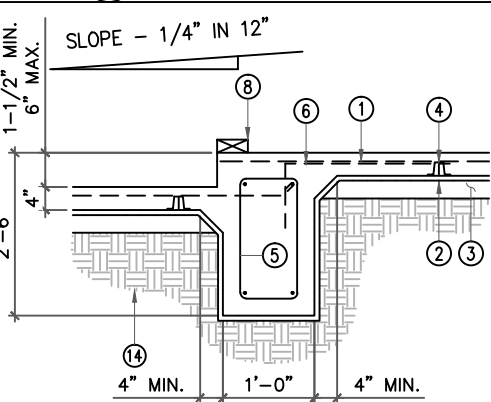


13 FOUNDATION DETAIL
NO SCALE

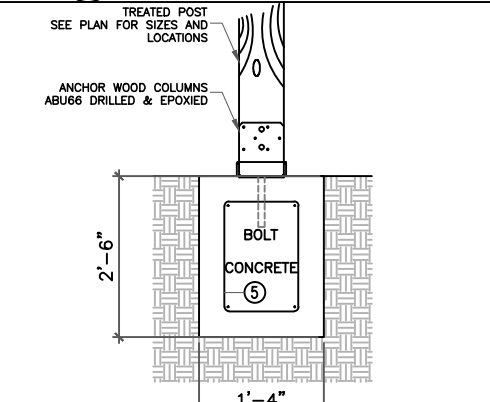

14 FOUNDATION DETAIL
NO SCALE

- FOUNDATION BUBBLE NOTES**
1. #3 @ 16" O.C. EA. WAY
 2. 6 MIL POLYETHYLENE VAPOR BARRIER EXTEND FOR FULL COVERAGE UNDER ENTIRE FLOOR SLAB
 3. 4" SAND LEVELING LAYER
 4. REINFORCING SUPPORT CHAIR AT 48" ON CENTER EACH WAY
 5. 2 - CONTINUOUS #5 BARS TOP AND BOTTOM WITH #3 STIRRUUPS AT 18" O.C.
 6. #3 DOWEL WITH 16"x24" LEGS AT 24" O.C. (NOT DONE UNLESS BEAM AND SLAB ARE SEPARATE POURS)
 7. FINISH GRADE: SLOPE PER SITEMARK
 8. 2" x PLATE
 9. 1 - CONTINUOUS #5 BAR
 10. 2" x PLATE
 11. #4 REBAR-TIE AT 16" O.C.
 12. GRADE BEAM REBAR MUST BE 3" FROM EDGES
 13. 3 - CONTINUOUS #5 BARS TOP AND BOTTOM WITH #3 STIRRUUPS AT 18" O.C.
 14. COMPACT SELECT FILL MIN 24" OR PER SOIL REPORT

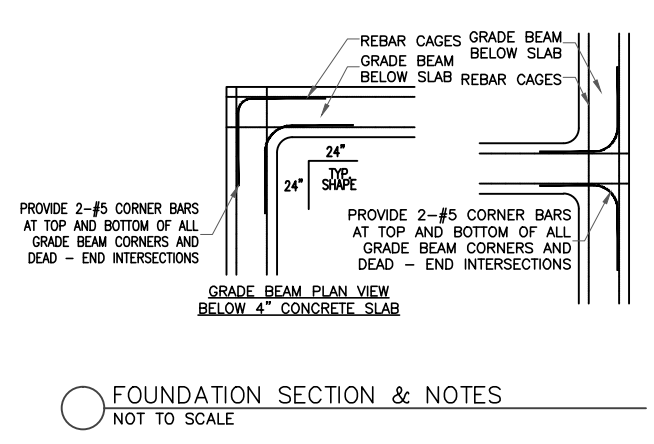


FOUNDATION NOTES

SCALE: N.T.S.

PROJECT: **RANGEL BUILDERS LLC**
ADDRESS: 1610 NORTH TRAVIS
LIBERTY, TX 77575

SHEET NO.

S2

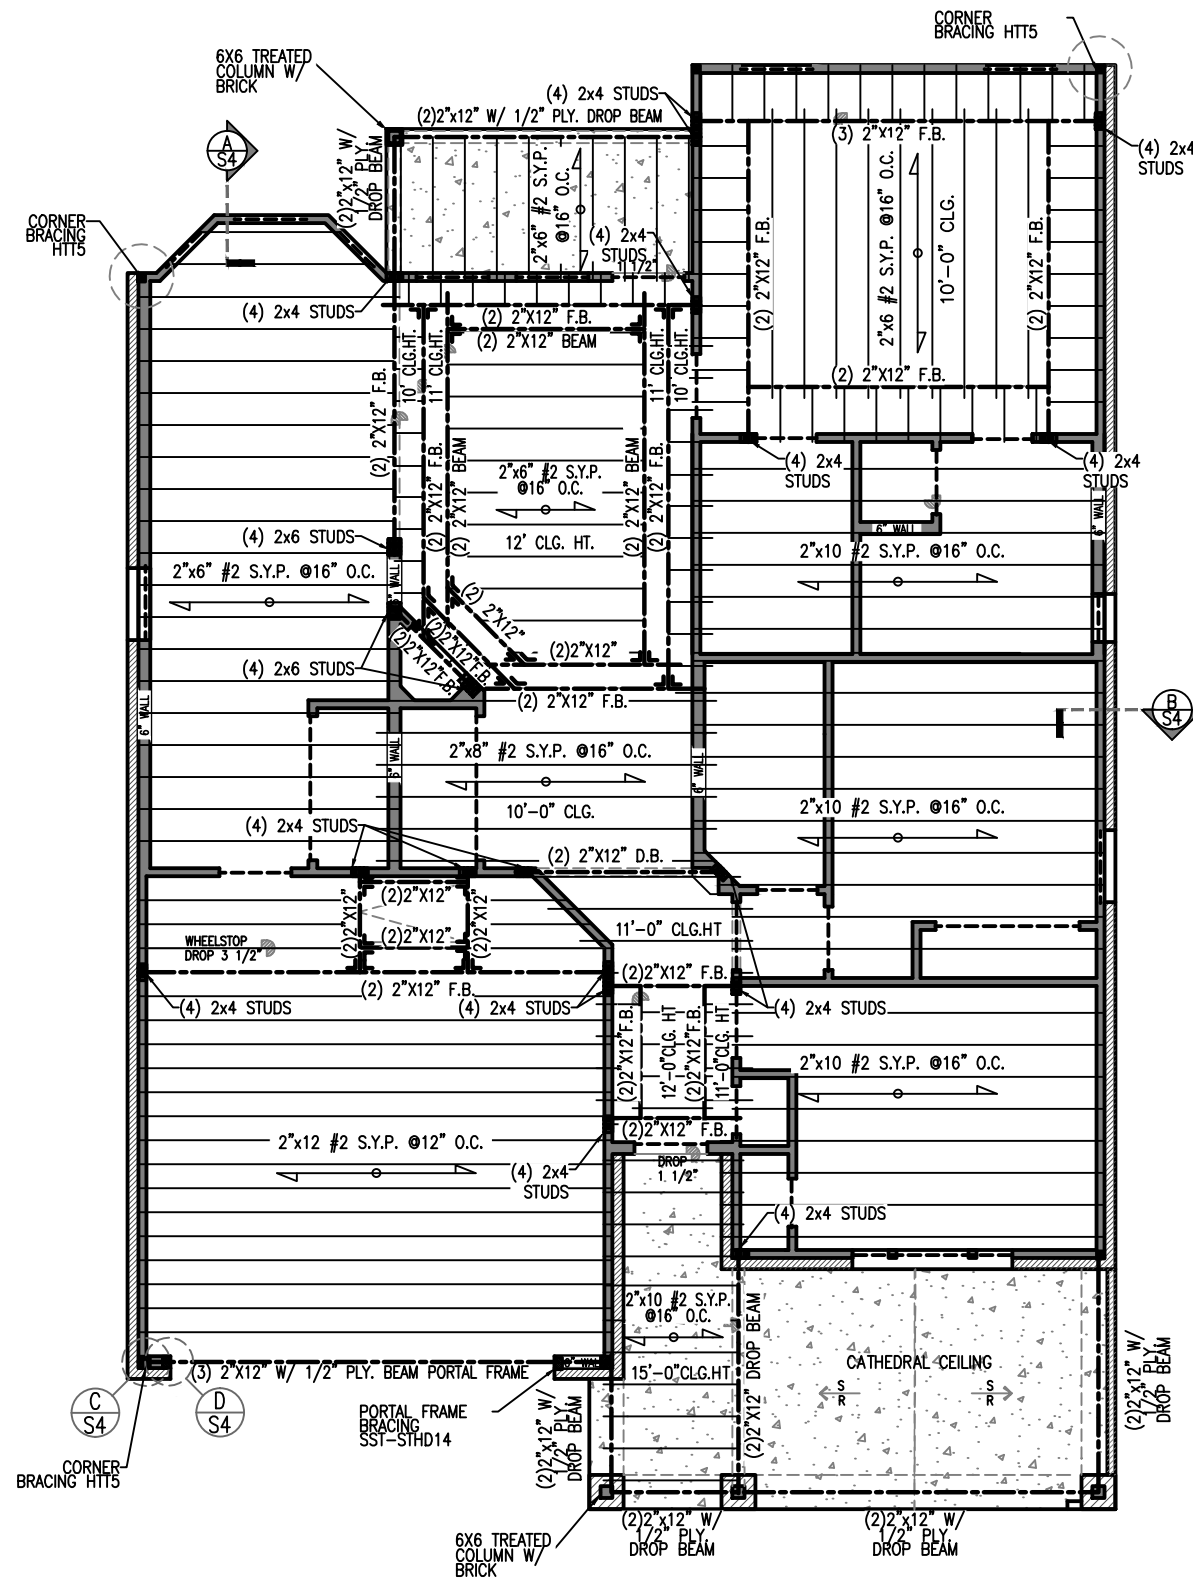

CEILING FRAMING NOTES

SEE NOTES ON SHEET "S4"

CEILING FRAMING PLAN

SCALE: 1/8" = 1'-0"

PROJECT: RANGEL BUILDERS LLC

ADDRESS: 1610 NORTH TRAVIS

LIBERTY, TX 77575

SHEET NO.

S3

	LIVE LOAD
ATTICS W/ LIMITED STORAGE	20
ATTIC W/O STORAGE	10
DECKS	40
EXTERIOR BALCONIES	60
FIRE ESCAPES	40
GUARDRAILS AND HANDRAILS	200i
GUARDRAILS IN-FILL COMPONENTS	50i
PASSENGER VEHICLE GARAGES	50a
ROOMS OTHER THAN SLEEPING ROOMS	40
SLEEPING ROOMS	30
STAIRS	40c

CEILING FRAMING NOTES

(UNLESS OTHERWISE NOTED)

1. CEILING JOISTS - S.Y.P. #2.
2. TYP. CEILING JOIST - 2"x6" @ 16" O.C. (U.N.O.)
3. ALL BEAMS AND HEADERS SHALL BE S.Y.P. #2.


HEADER SCHEDULE

(UNLESS OTHERWISE NOTED)


SPAN	HEADER
2'-6" OR LESS	2-2x4's
4'-6" OR LESS	2-2x6's
6'-0" OR LESS	2-2x8's
7'-6" OR LESS	2-2x10's

DESIGN LOADS:


LIVE LOAD = 20 PSF.
 DEAD LOAD = 10 PSF.
 WIND LOAD = 110 MPH
 3 - SECOND GUST

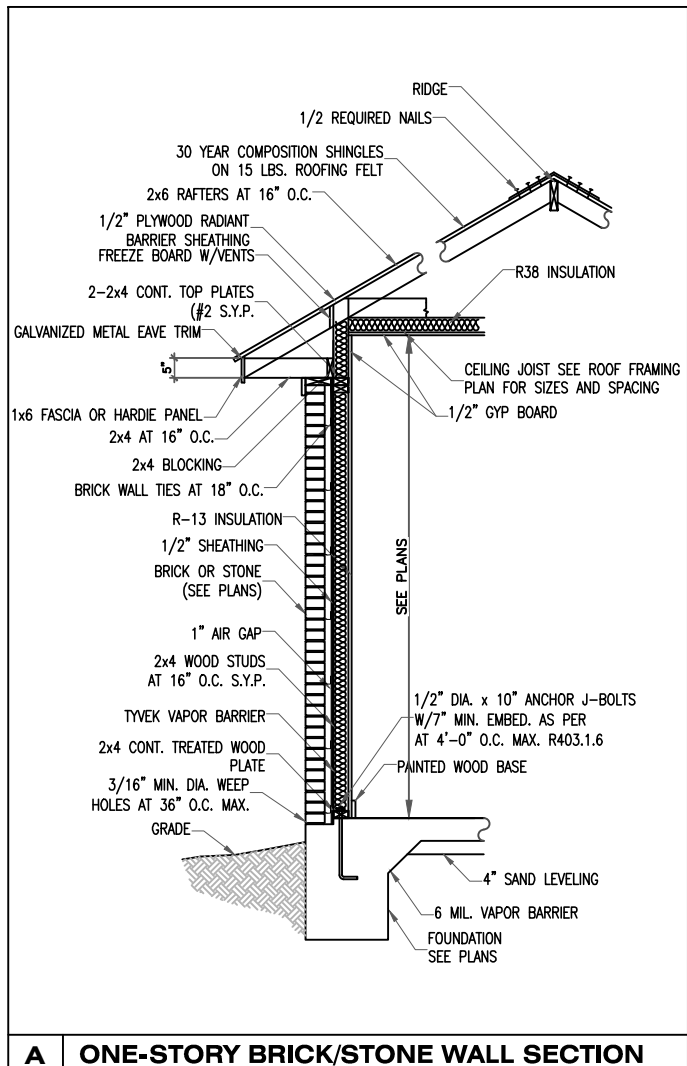


A ONE-STORY BRICK/STONE WALL SECTION

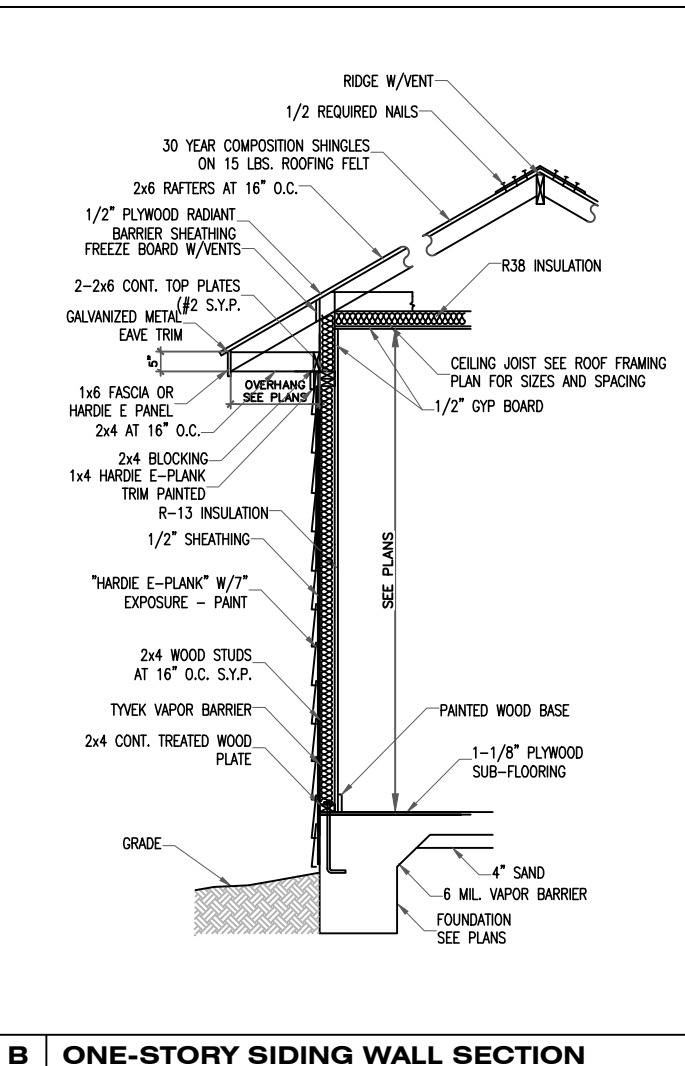


B ONE-STORY SIDING WALL SECTION

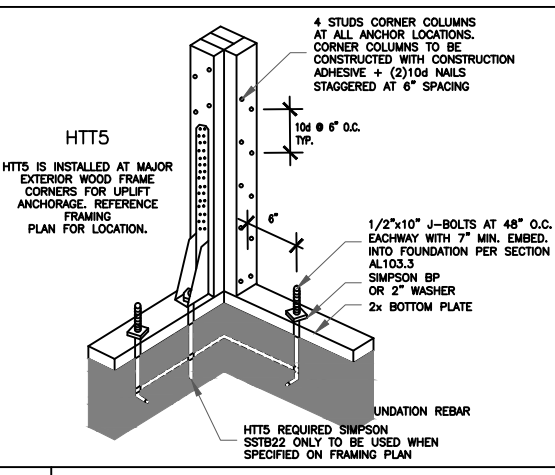

C CORNER BRACING

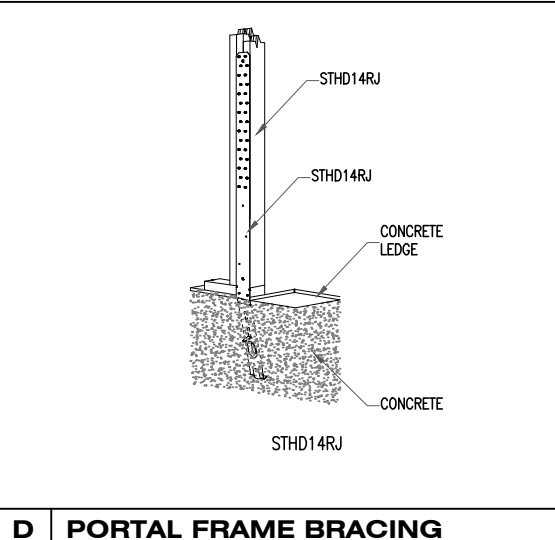

D PORTAL FRAME BRACING

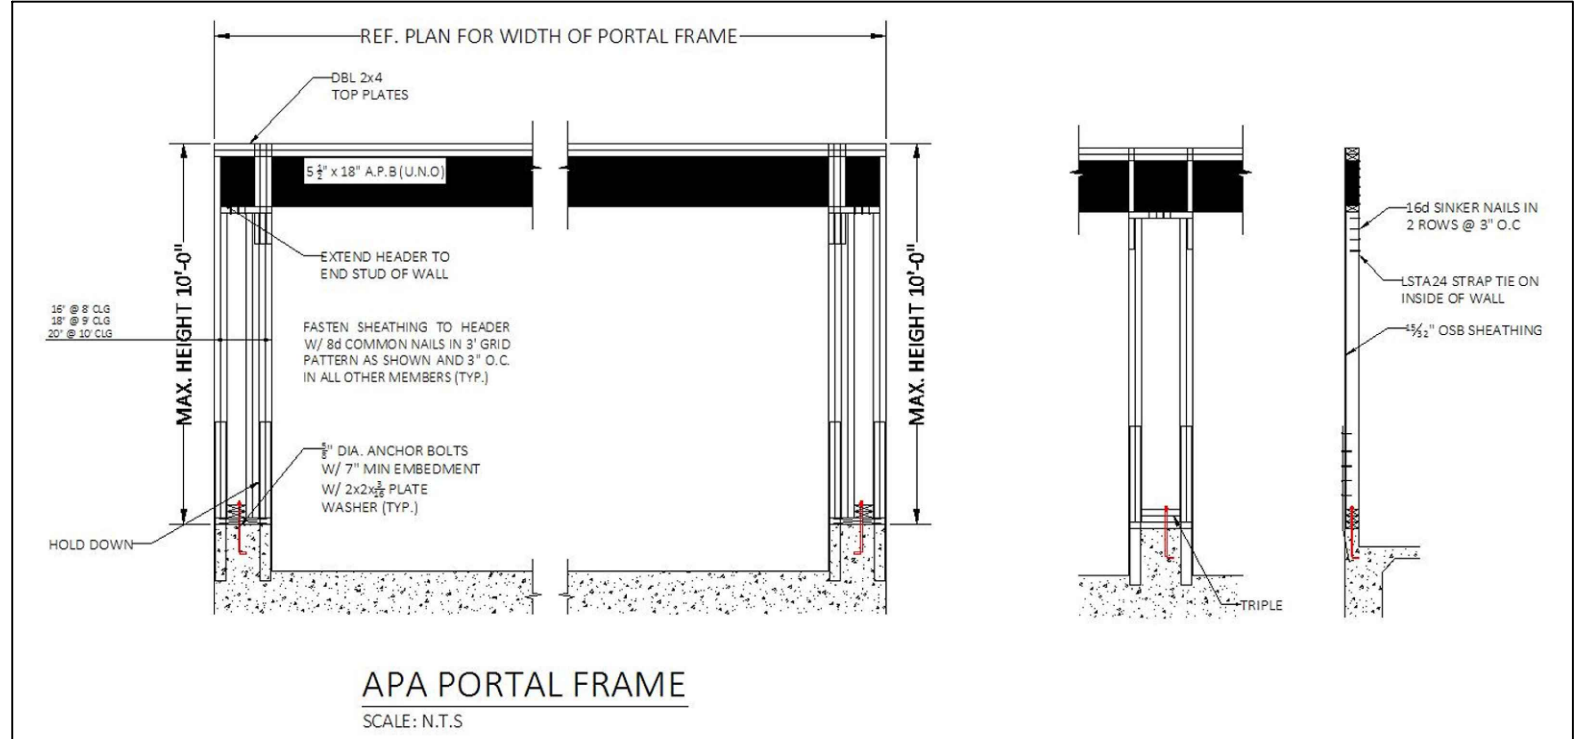

APA PORTAL FRAME
SCALE: N.T.S.

NOTE: PROVIDE DOUBLE/TRIPLE JOISTS UNDER ALL WALL TO JOIST & UNDER EACH POINT LOAD.

NOTE: PROVIDE BLOCKING UNDER ALL WALLS THAT RUN PERPENDICULAR TO THE FLOOR JOISTS. BLOCKING WILL BE MIN 2-2X8 OR 2-2XJOISTS DEPTH.

A.P.B. = ANTHONY'S POWER BEAM 3000 Fb OR EQUAL

PROJECT: **RANGEL BUILDERS LLC**
 ADDRESS: **1610 NORTH TRAVIS**
LIBERTY, TX 77575

TABLE A-23-B ROOF AND FLOOR ANCHORAGE AT EXTERIOR WALLS				
BASIC WIND SPEED X 1.81 FOR KNOTS	LOCATION	NUMBER OF NAILS		
		EXPOSURE		
		B	C	D
80	ROOF TO WALL	6-8d	8-8d	8-10d
	FLOOR TO FLOOR	---	4-10d	6-10d
	FLOOR TO FOUNDATION	---	4-10d	4-10d
90	ROOF TO WALL	8-8d	8-10d	10-10d
	FLOOR TO FLOOR	---	6-10d	8-10d
	FLOOR TO FOUNDATION	---	4-10d	6-10d
100	ROOF TO WALL	8-10d	10-10d	12-10d
	FLOOR TO FLOOR	6-10d	8-10d	10-10d
	FLOOR TO FOUNDATION	4-10d	6-10d	8-10d
110	ROOF TO WALL	10-10d	12-10d	12-10d
	FLOOR TO FLOOR	8-10d	10-10d	10-10d
	FLOOR TO FOUNDATION	6-10d	8-10d	8-10d

FOR FLOOR TO FOUNDATION ANCHORAGE, SEE SECTION 2365.5.4
 NUMBER OF COMMON NAILS LISTED IS TOTAL REQUIRED FOR EACH TIE STRAP.
 THE TIE STRAPS SHALL BE SPACED AT 48" ON CENTER ALONG THE LENGTH OF
 THE WALL. THE NUMBER OF NAILS ON EACH SIDE OF THE ROOF OR FLOOR
 PLATE JOINTS SHALL BE EQUAL. NAILS SHALL BE SPACED TO AVOID SPLITTING
 THE WOOD, SEE FIGURES A-23-1 FOR ILLUSTRATIONS OF THESE TIE STRAPS.

- NOTE:**
- PROVIDE 2 x 6 PURLIN BRACING WITH 2 x 4 "I" COLUMN MINIMUM BRACED BACK TO LOAD BEARING WALL OR FLOAT BEAM.
 - PROVIDE 2 x 6 COLLAR BEAMS @ EVERY OTHER RAFTER @ 3' TO 4' BELOW RIDGE LINE.
 - RIDGE, HIP, AND VALLEY RAFTERS TO BE NEXT SIZE LARGER THAN CONNECTING MEMBER.

NOTE:
 ALL NEW RAFTERS 2x6 @ 16" O.C.
 SYP. #2 GRADE OR BETTER (U.N.O.)

COORDINATE ALL DIMENSIONS, RECESS AND DROPS W/ ARCHITECTURAL DWGS

TABLE A-23-C RIDGE TIE-STRAP NAILING			
BASIC WIND SPEED X 1.81 FOR KNOTS	NUMBER OF NAILS		
	EXPOSURE		
	B	C	D
80	6-10d	8-10d	10-10d
90	8-10d	10-10d	12-10d
100	10-10d	12-10d	14-10d
110	12-10d	14-10d	16-10d


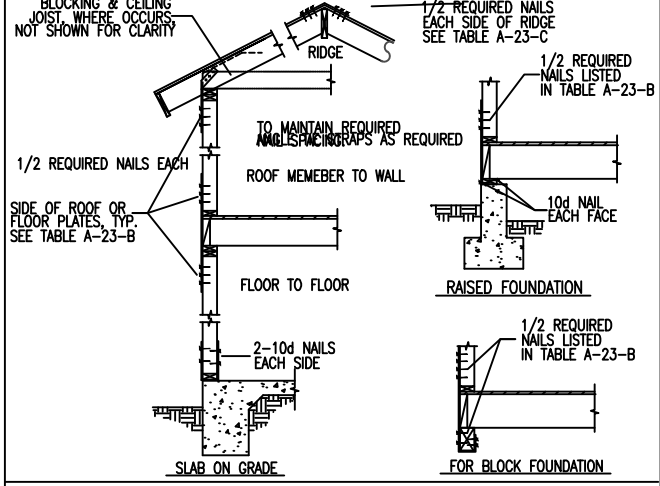



FIGURE A-23-1 COMPLETE LOAD PATH DETAILS

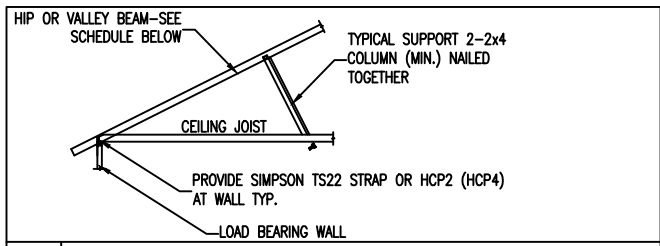

HIP OR VALLEY BEAM BRACING

USE	LIVE LOAD
ATTICS W/ LIMITED STORAGE	20
ATTIC W/O STORAGE	10
DECKS	40
EXTERIOR BALCONIES	60
FIRE ESCAPES	40
GUARDRAILS AND HANDRAILS	200i
GUARDRAILS IN-FILL COMPONENTS	50i
PASSENGER VEHICLE GARAGES	50a
ROOMS OTHER THAN SLEEPING ROOMS	40
SLEEPING ROOMS	30
STAIRS	40c

- ROOF NOTES:**
- ALL SLOPES FROM FRONT TO BACK ELEVATIONS ARE SEE PLAN / 12 PITCH AND SHALL HAVE 16" OVERHANG FROM FRAME UNLESS NOTED OTHERWISE.
 - ALL SLOPES FROM SIDE TO SIDE ELEVATIONS ARE SEE PLAN / 12 PITCH AND SHALL HAVE 16" OVERHANG FROM FRAME UNLESS NOTED OTHERWISE.
 - ALL RAKE OVERHANGS SHALL BE 16" FROM FINISH WALL UNLESS NOTED OTHERWISE.
 - ALL RAFTERS SHALL BE #2-2 x 6 @ 16" O.C. OR BETTER UNLESS NOTED OTHERWISE.
 - PROVIDE VALLEY FLASHING WHERE ROOF PITCHES CHANGE AND WHERE ROOF INTERSECTS WITH VERTICAL SURFACES.
 - GUTTERS AND DIVERTERS TO BE PROVIDED BY CONTRACTORS AS REQUIRED. (SEE CUSTOMER)
 - CONTRACTORS SHALL PROVIDE ADEQUATE ATTIC VENTILATION PER BUILDING CODES THROUGH CONTINUOUS SOFFIT VENTS TO RIDGE OR TURBINE VENTS. VERIFY WITH OWNER.

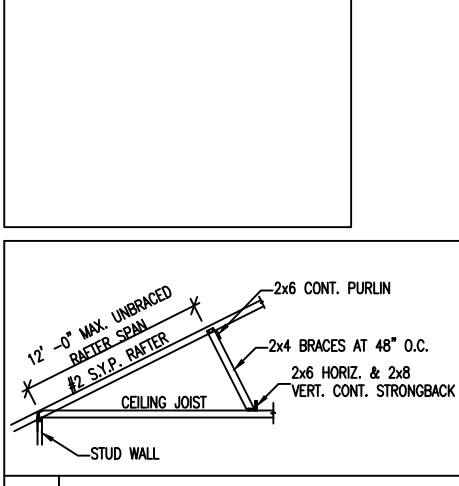


RAFTER BRACING DETAIL

NOTE: CORROSION RESISTANT STEEL TIE STRAP 1 1/8" X 0.036" (129MMx0.91MM) 0.036 INCH (0.91MM) (NO 20 GALVANIZED SHEET GAGE) AS 48" (1219MM) ON CENTER TYPICAL.

DESIGN LOADS

LIVE LOAD = 20 PSF.
 DEAD LOAD = 10 PSF.
 WIND LOAD = 110 MPH
 3 - SECOND GUST

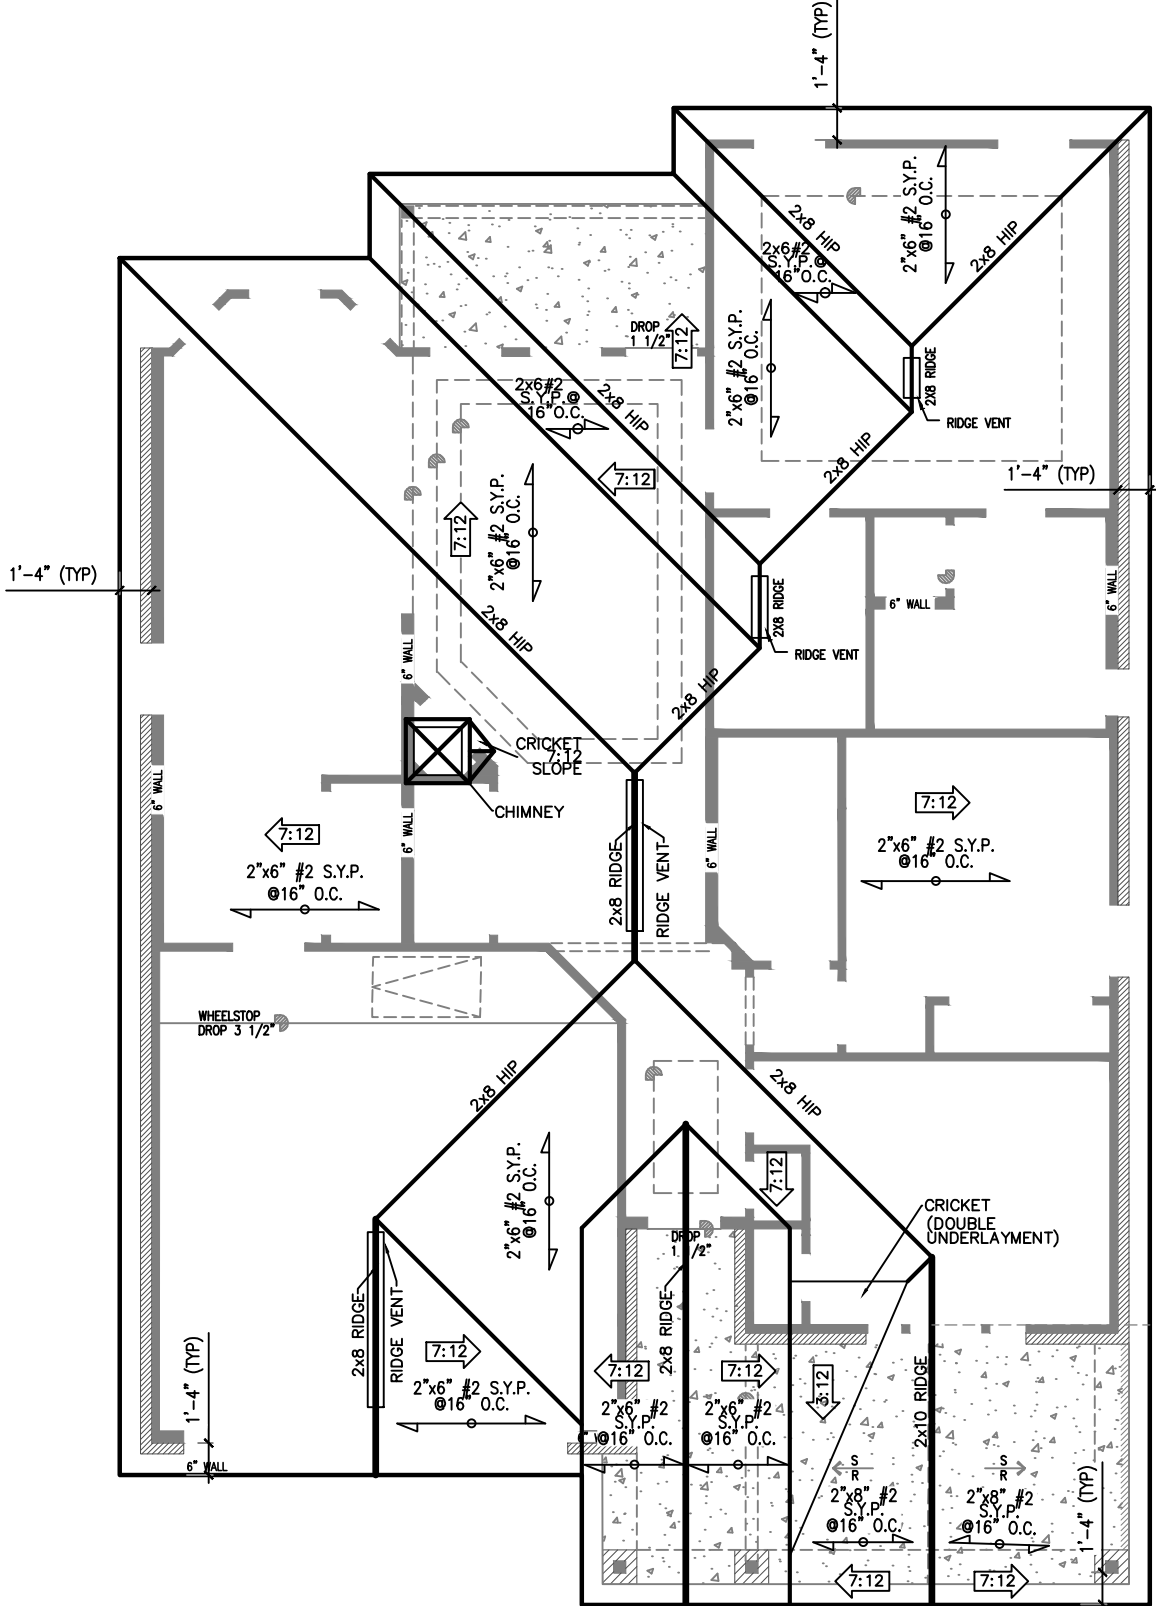




ROOF FRAMING PLAN

SCALE: 1/8" = 1'-0"

PROJECT: **RANGEL BUILDERS LLC**
 ADDRESS: **1610 NORTH TRAVIS**
LIBERTY, TX 77575

SHEET NO.

S5

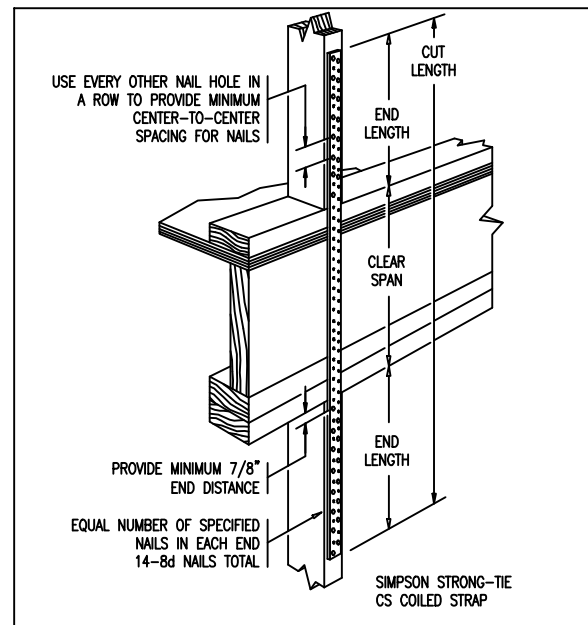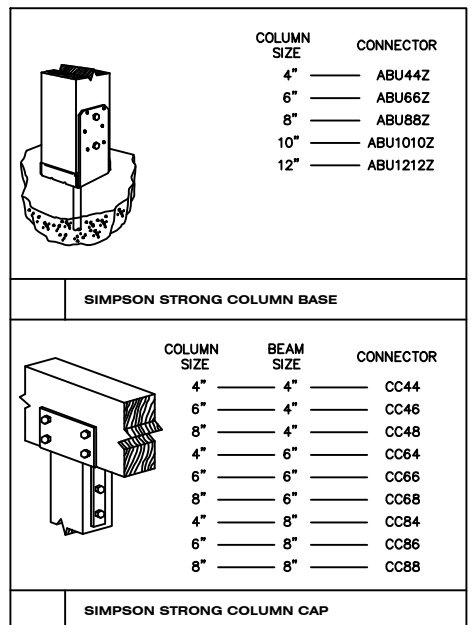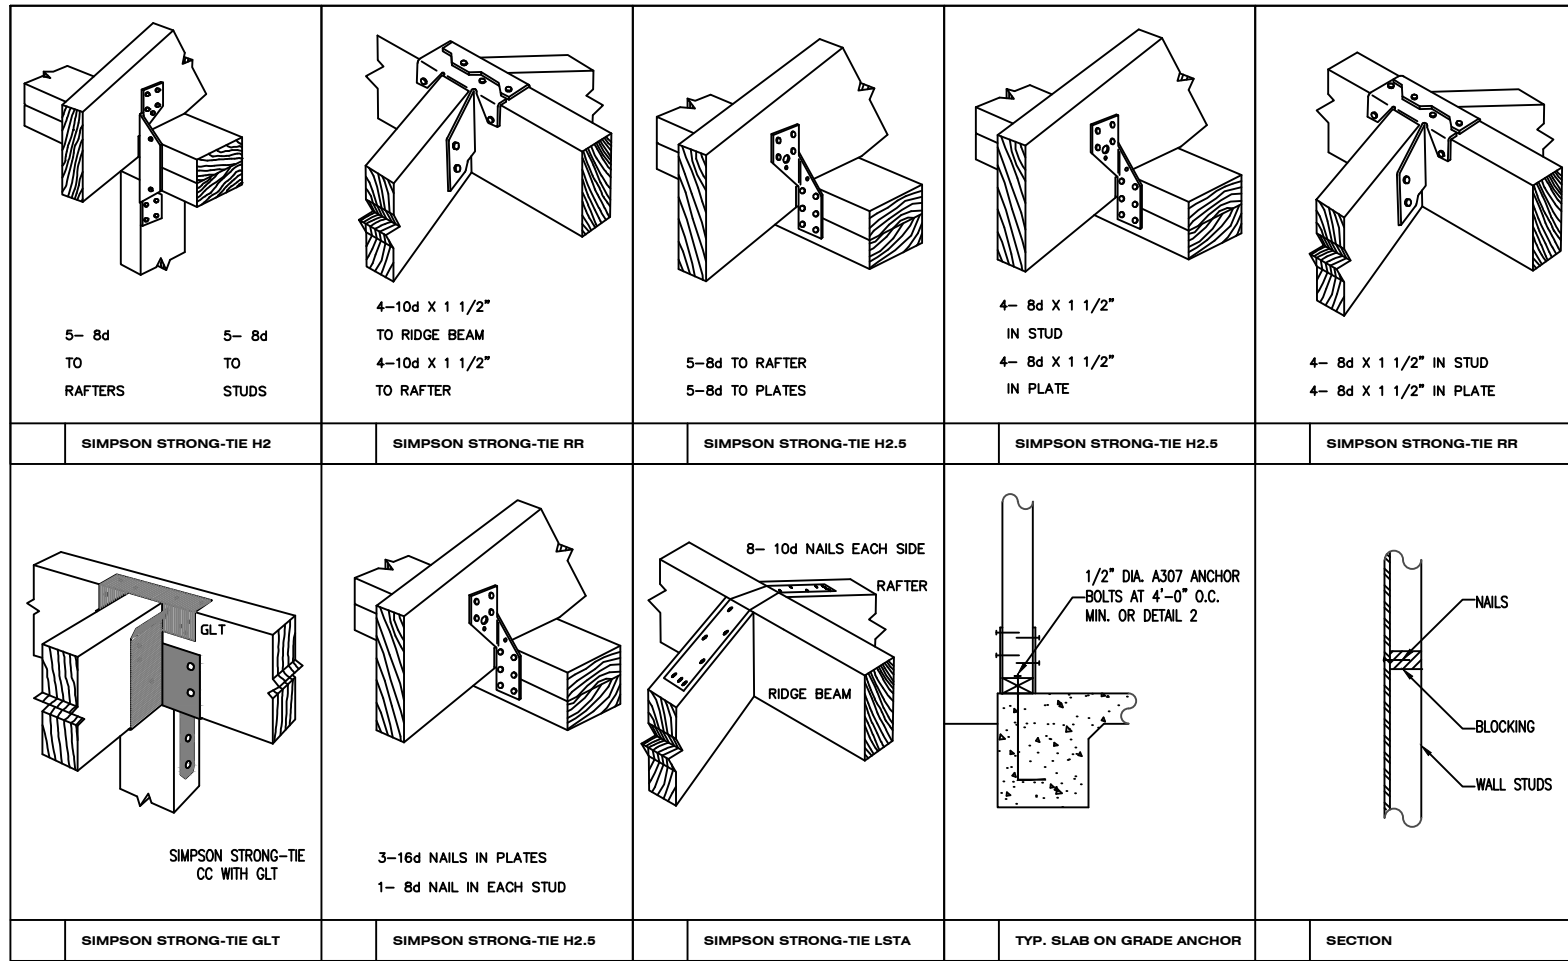

DESIGN LOADS:

LIVE LOAD = 20 PSF.
DEAD LOAD = 10 PSF.
WIND LOAD = 110 MPH
3 - SECOND GUST

NOTES:

- INSTALL HURRICANE STRAPS PER DETAILS D1 THRU D4 FOR STRAPS FOR MATCHING RAFTERS SEE D5.
- WHERE RAFTERS ARE STAGGARED USE DETAIL RR ON D2.
- WHERE RAFTERS AND STUDS MATCH USE DETAIL H2 ON D1.
- WHERE STUD MATCH FROM THE FIRST FLOOR TO THE SECOND FLOOR USE CS ON D1.
- WHERE RAFTERS DO NOT MATCH TO STUDS USE H2 ON D2.
- TO TIE STUDS TO TOP PLATE WHERE RAFTERS DO NOT MATCH USE RSP4 ON D3.
- CONNECT STUDS TO BOTTOM PLATE PER RSP4 ON D3.
- ALL WALLS SHALL HAVE DIAGONAL BRACING PER WW ON D4. ALTERNATE BRACING IS 1X4 LET-IN FROM TOP PLATE TO BOTTOM PLATE.

FASTENER SCHEDULE FOR STRUCTURAL MEMBERS
TABLE R602.3(1)

DESCRIPTION OF BUILDING ELEMENTS	NUMBER & TYPE OF FASTENER a,b,c,d	SPACING OF FASTENERS
Joist to sill or girder, toe nail	3-8d	-
1"x6" subfloor or less to each joist, face nail	2-8d 2 staples, 1-3/4	-
2" subfloor to joist or girder, blind & face nail	2-16d	-
Sole plate to joist or blocking, face nail	16d	16" O.C.
Top or sole plate to stud, end nail	2-16d	-
Stud to sole plate, toe nail	4-8d or 2-16d	-
Double studs, face nail	16d	24" O.C.
Double top plates, face nail	16d	16" O.C.
Sole plate to joist or blocking at braced wall panels	3-16d	16" O.C.
Double top plates, minimum 48" offset of end joints, face nail in lapped area	8-16d	-
Blocking between joists or rafters to top plate, toe nail	3-8d	-
Rim joist to top plate, toe nail	8d	6" O.C.
Top plates, laps at corners & intersections, face nail	2-10d	-
Built-up header, two pieces with 1/2" spacer	16d	16" O.C. along each edge
Continued header, two pieces	16d	16" O.C. along each edge
Ceiling joists to plate, toe nail	3-8d	-
Continuous header to stud, toe nail	4-8d	-
Ceiling joist, laps over partitions, face nail	3-16d	-
Ceiling joist to parallel rafters, face nail	3-10d	-
Rafter to plate, toe nail	3-8d	-
1" brace to each stud & plate, face nail	2-8d 2 staples, 1-3/4	-
1"x6" sheathing to each bearing, face nail	2-8d 2 staples, 1-3/4	-
1"x8" sheathing to each bearing, face nail	2-8d 3 staples, 1-3/4	-
Wider than 1"x8" sheathing to each bearing, face nail	3-8d 4 staples, 1-3/4	-
Built-up corner studs	16d	24" O.C.
Built-up girders & beams, 2-inch lumber layers	20d	Nail each layer as follows: 32" O.C. at top & bottom & staggered. Two nails at ends & at each splice
2" planks	2-16d	At each bearing
Roof rafters to ridge, valley or hip rafters: toe nail	4-16d	-
face nail	3-10d	-
Rafter ties to rafters, face	3-8d	-
Wood structural panels, subfloor, roof & wall sheathing to framing, & particleboard wall sheathing to framing		
5/16 - 1/2	6d common nail (subfloor, wall) 8d common nail (roof)	6 12 ⁹
19/32 - 1	8d common nail	6 12 ⁹
1-1/8 - 1-1/4	10d common nail or 8d deformed nail	6 12

BRACING DETAILS

SCALE: N.T.S.

NAILING DETAILS

SCALE: N.T.S.

PROJECT: **RANGEL BUILDERS LLC**
ADDRESS: **1610 NORTH TRAVIS**
LIBERTY, TX 77575

SHEET NO.

S6

GENERAL NOTE

FRAMING DESIGN CRITERIA BASED ON 2020 NFPA SPAN TABLES FOR JOISTS AND RAFTERS, AND SPIB GRADING RULES. VERIFY ALL DIMENSIONS, DROPS, OFFSETS, BRICKLEDGES, INSERTS AND OPENINGS WITH ARCHITECTURAL DRAWINGS.


STUD WALL FRAMING NOTE

FRAME EXTERIOR LOAD-BEARING STUD WALLS WITH UNBRACED HEIGHT GREATER THAN 10'-0" WITH 2X6 STUDS @ 16" O.C. FRAME INTERIOR LOAD-BEARING STUD WALLS WITH UNBRACED HEIGHT GREATER THAN 10'-0" WITH 2 - 2X4 STUDS @ 16" O.C. OR 2X6 STUDS @ 16" O.C.

STUD WALLS SHALL BE DIAGONALLY BRACED w/ 1 X 4 LET-IN AT EACH END, AT 25' MAX. SPACING BETWEEN WALL ENDS.

STRAP TIES MST @ SECOND FLOOR AND ROOF, SPACED @ 32" O.C.

H3 CONNECTORS AT SILL PLATE @ 16" O.C.

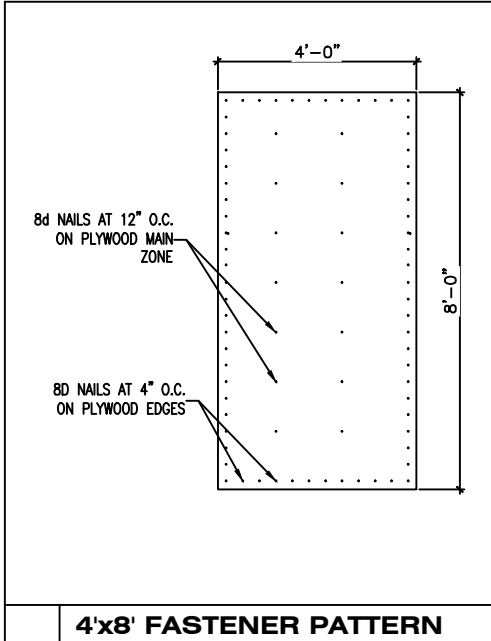

NOTES:

- ALL EXTERIOR CORNER WALLS SHALL HAVE A MINIMUM OF ONE LAYER OF 1/2" PLYWOOD SHEATHING (STRUCTURAL GRADE) WITH 8d NAILS @ 4" O.C.
- SEE DETAIL ABOVE FOR SHEAR WALLS. PROVIDE THE SHEATHING/NAILING PATTERN AS INDICATED ON THESE DRAWINGS.
- 1/2" DRYWALL WITH 5d COOLER NAILS @ 7" O.C. AT EDGES PROVIDE THIS AS STANDARD CONSTRUCTION FOR BOTH SIDES OF ALL INTERIOR STUD WALLS.
- PROVIDE BLOCKING AT ALL SHEATHING EDGES. PROVIDE DOUBLE STUDS w/ SIMPSON HD5A, HIT22 AT EACH END OF THE SHEAR WALL.
- PROVIDE 1/2" ANCHOR BOLTS @ 4'-0" MAX. OR AT LEAST 2 BOLTS THE MIDDLE OF EACH SHEAR WALL.
- PROVIDE CONTINUOUS HURRICANE CLIPS FROM ROOF TO FOUNDATION AS REQUIRED BY LOCAL BUILDING CODE.
- PROVIDE ONE LAYER OF 1/2" PLYWOOD SHEATHING (STRUCTURAL GRADE)



GENERAL FRAMING NOTES

- HIP, VALLEY, AND RIDGE SHALL ALWAYS BE ONE SIZE LARGER THAN RAFTERS.
- PROVIDE COLLAR TIES AT UPPER 1/3 DISTANCE BETWEEN RIDGE BOARD AND JOIST AT 48" O.C.
- ALL RAFTERS 2X6 AT 16" O.C UNLESS OTHERWISE NOTED.
- DOUBLE FLOOR JOIST UNDER ALL PARTITIONS PARALLEL TO JOIST BELOW.
- PROVIDE CROSSBRIDGING AT 8'-0" O.C. ON ALL 2X12 JOISTS.
- PROVIDE RAFTER TIES AT ALL PLATES WHERE JOIST ARE PERPENDICULAR TO RAFTERS.
- PROVIDE 2- 2X6 STRONGBACK ON SPANS OVER 10'-0".
- ALL STRUCTURAL FRAMING SHALL HAVE A 19% MAXIMUM MOISTURE CONTENT AT TIME OF INSTALLATION.
- STUD WALLS EXCEEDING 10'-0" SHALL HAVE FIRESTOPS
- THE MAXIMUM UNSUPPORTED SPAN FOR 2 X 6 RAFTERS SHALL BE 10'-7". RAFTERS ARE TO BE SUPPORTED BY CONTINUOUS 2 X 6 BRACES AT 48" O.C. MAXIMUM ANGLE FOR 2 X 6 BRACES = 45 deg FROM VERT. MAXIMUM UNSUPPORTED LENGTH FOR 2 X 6 BRACES = 8'. ALL ROOF BRACING TO BE SUPPORTED BY A WALL, 2-2 X 6 STRONGBACK SUPPORTED BY JOISTS OR (2) 2 X 12 DEPENDING ON CEILING JOIST DIRECTION (PROVIDE BLOCKING AT BRACE LOCATIONS), (U.N.O.). PROVIDE 2 X 6 COLLAR TIES 48" O.C. IN THE UPPER THIRD OF THE RAFTERS, (U.N.O.).
- PROVIDE 26 GA. GALVANIZED IRON FLASHING AT ALL VALLEYS, HIPS, AND RIDGES WHERE APPLICABLE. ALSO APPLY FOR PIPES PROJECTING THROUGH ROOF WITH FLANGE AND EXTEND FLANGE 8" BEYOND SLEEVE.
- ALL BEAM AND HEADER MATERIAL SHALL BE #2 SD19 SYP. ALL RAFTERS AND JOIST MATERIAL SHALL BE #2 SD19 SYP.
- ALL WALL STUD SHALL BE STUD GRADE SD19 FIR 16" O.C.
- ALL STEEL SHALL CONFORM TO ASTM A-36.
- ROOF LIVE LOAD = 20 PSF, SECOND FLOOR LIVE LOAD = 40 PSF, CEILING LIVE LOAD = 10 PSF. WIND LOAD 110 MPH
- ROOF DECKING SHALL BE 1/2" EXPOSURE 1 (CDX) OR WAFFERBOARD APA RATED SHEATHING (24/0). SECOND FLOOR DECKING SHALL BE APA 1 1/8 PLYWOOD OR 2X6 T & G INSTALLED DIAGONALLY.
- FRAMING CONNECTORS SHALL BE SIMPSON STRONG-TIE MTS12 @ 32" O.C.

- CORNER SHEATHING (FROM CORNER TO A DISTANCE 8'-0" FROM CORNER) PROVIDE 1/2" PLYWOOD SHEATHING. BLOCK ALL UNSUPPORTED EDGES OF SHEATHING. NAIL w/ 8d NAILS AT 4" O.C. EDGES, 12" O.C. FIELD.
- ALL EXTERIOR WALL TO USE 1/2" PLYWOOD O.S.B. (MIN) NAIL 4" O.C. AT EDGES, & 12" O.C. AT FIELD w/ 8d NAILS TYP. (U.N.O.)
- INSTALLATION: DRIVE NAILS FLUSH. DO NOT PENETRATE THE SURFACE OF THE SHEATHING.
- SHEATHING NOTED ON PLAN IS IN ADDITION TO CORNER SHEATHING. PROVIDE 1/2" PLYWOOD SHEATHING. INSTALL IN ACCORDANCE WITH ITEMS 1 AND 5 ABOVE.

WIND STORM NOTES:

- RAFTER HURRICANE TIES- CONNECT ALTERNATE RAFTERS TO SUPPORTS WITH SIMPSON H2.5 HURRICANE TIE
- ALIGN OPPOSING RAFTERS @ RIDGE AND CONNECT WITH SIMPSON LSTA STRAPS TIE WITH 10-10d NAILS (5 EA. SIDE)
- ROOF BRACING- 2 X 6 PURLIN WITH 2 X 4 BRACE @ 48" O.C. TO BEAM OR WALL BELOW
- CEILING JOIST- SYP. # 2 2x6 @ 16" O.C. U.N.O.
- ALL BEAM CONNECTIONS SIMPSON HGB OR HGLT
- PROVIDE FULL BEARING UNDER BEAMS CONTINUOUSLY TO FOUNDATION
- DL- 5 PSF LL 10 PSF UNIFORM DIST. LOAD FROM WALL ABOVE #/LF POINT LOAD FROM WALL OR COLUMN ABOVE # ALL NON LOAD BEARING TRUSSES @ 120 #/LF MIN. PLUS LOAD FROM WALL ABOVE ALL FLUSH BEAM CONNECTIONS SIMPSON HGB OR HGLT ALL FLUSH STEEL TO STEEL BEAMS CONNECTIONS 2- L 4" X 4" X 1/4" X 9' WITH 6- 3/4" @ A307 BOLTS

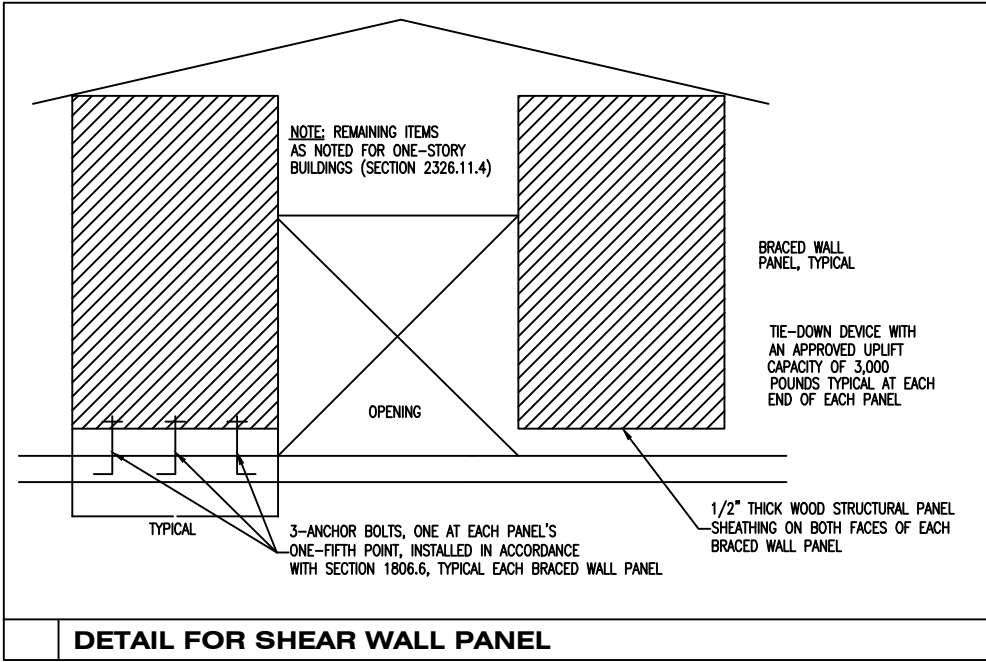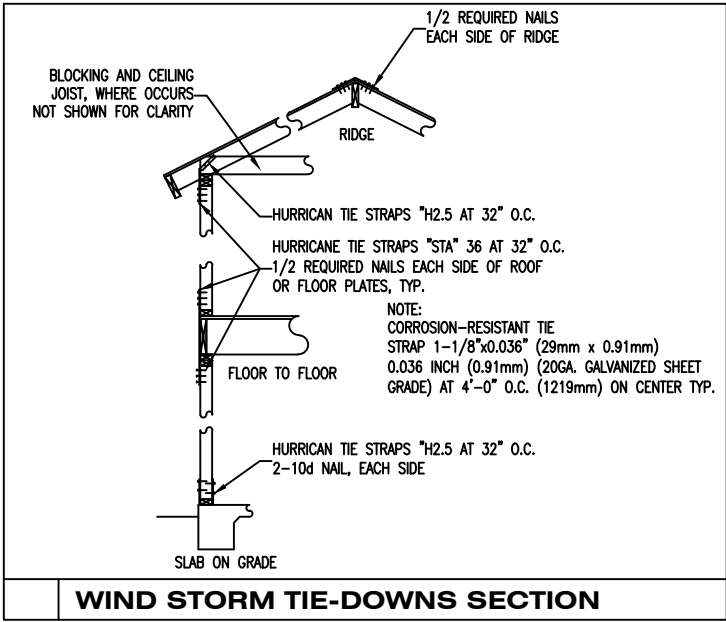

ROOF AND FLOOR ANCHORAGE AT EXTERIOR WALLS

BASIC WIND SPEED (MPH) x 1.61 FOR KPH	LOCATION	NUMBER OF NAILS		
		B	C	D
110	ROOF TO WALL	10-10d	12-10d	12-10d
	FLOOR TO FLOOR	8-10d	10-10d	10-10d
	FLOOR TO FOUNDATION	6-10d	8-10d	8-10d

RIDGE TIE-STRAP NAILING

BASIC WIND SPEED (MPH) x 1.61 FOR KPH	NUMBER OF NAILS		
	B	C	D
110	12-10d	14-10d	16-10d

