




24018101

REVIEWED FOR COMPLIANCE


Performance of this review
does not relieve the applicant
from full responsibility to
comply with all applicable
codes, ordinances and
regulations 11/02/24

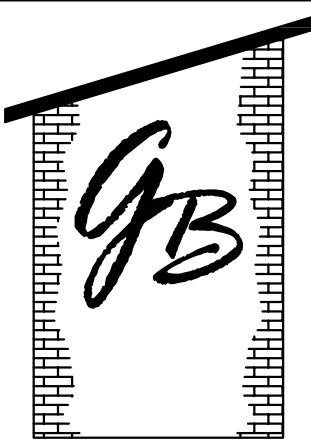

Gonzalez Building
Designs


Houston, T.X.
(832) 618-4465

gonzalezbuildingdesigns@gmail.com

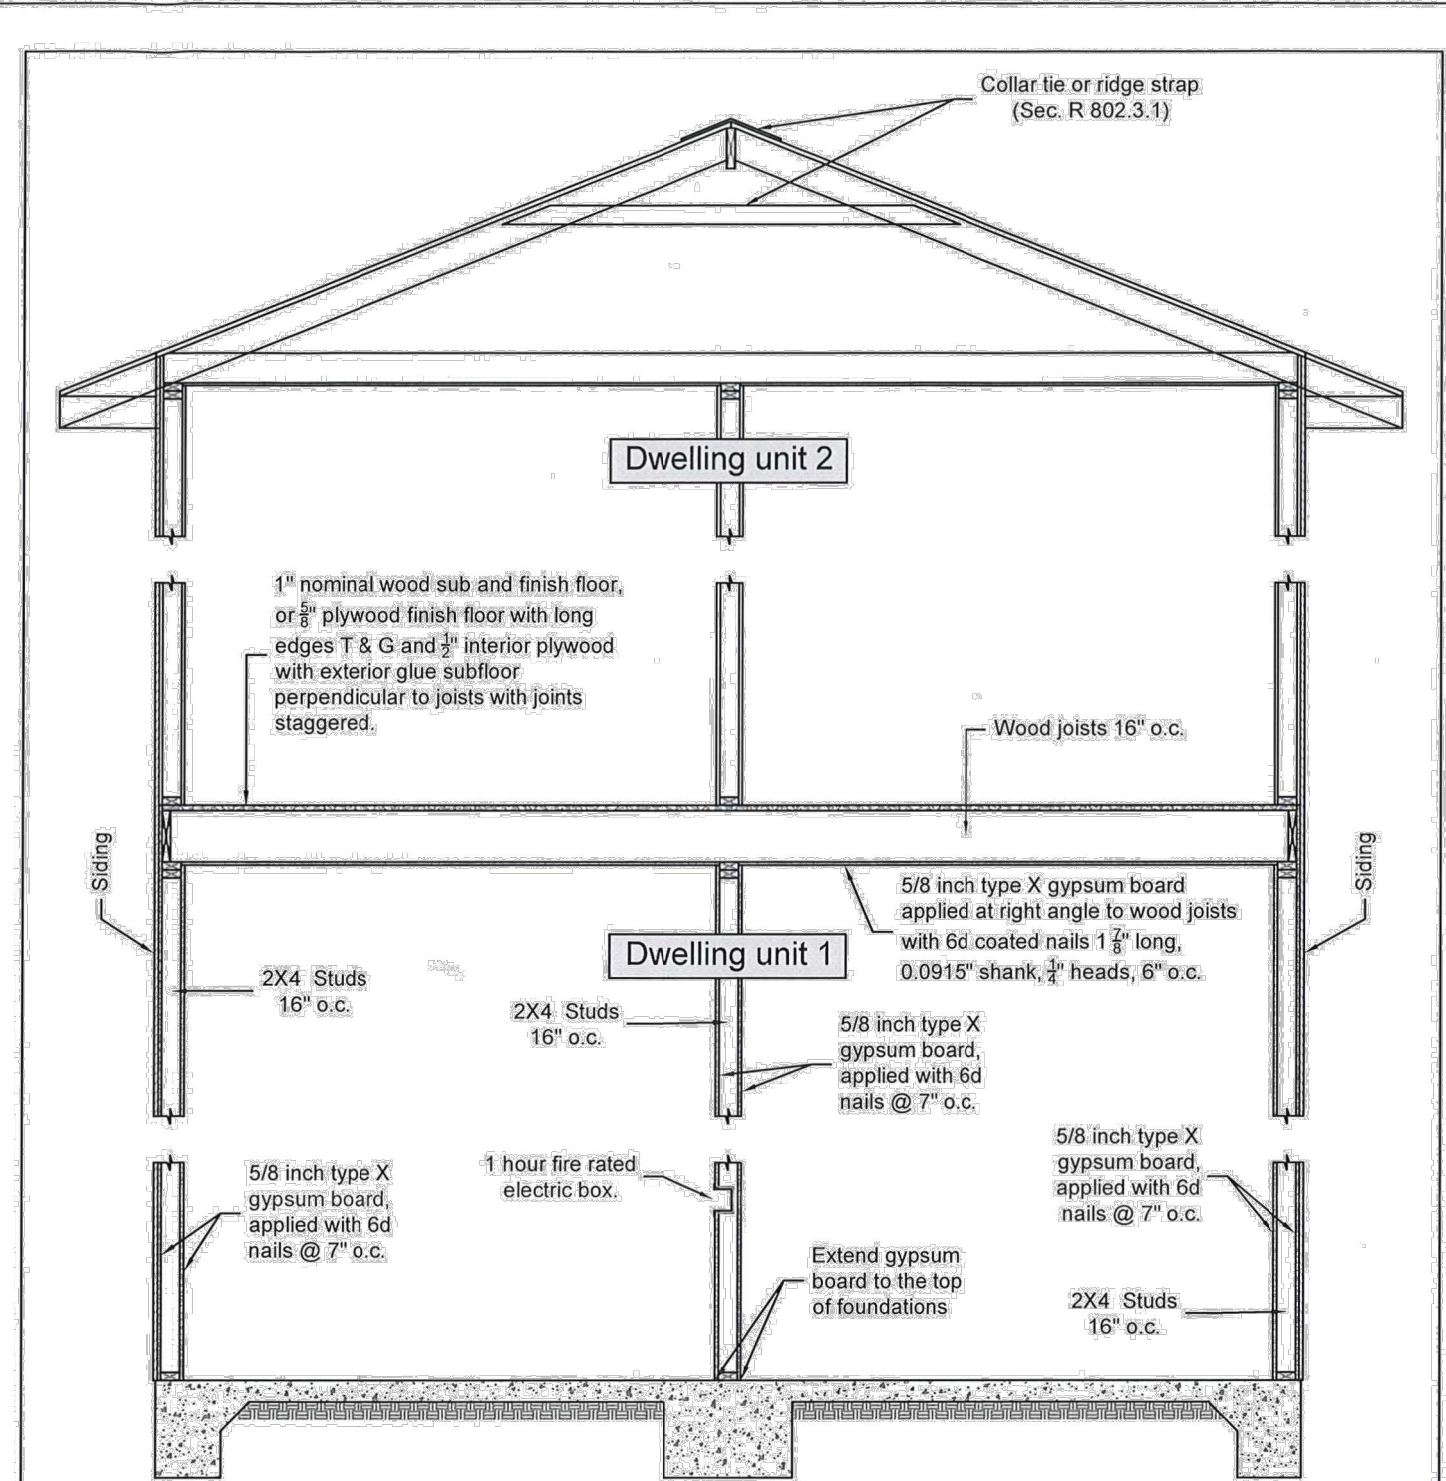


- Notes:
1. The structural framing supporting the fire-resistance-rated floor/ceiling assemblies shall have an equal or greater fire-resistive rating.
 2. Penetrations of wall or floor/ceiling assembly shall be 1 hr fire-rated and shall comply with section R302.4

	STANDARD DRAWING CITY OF HOUSTON HOUSTON PUBLIC WORKS BUILDING CODE ENFORCEMENT	TWO FAMILY DWELLING HORIZONTAL SEPARATION 1002 WASHINGTON AVE., HOUSTON, TEXAS 77002	APPROVED BY: BUILDING OFFICIAL DATE: 10-27-2019 DWG NO: 19-05-R
--	---	--	--

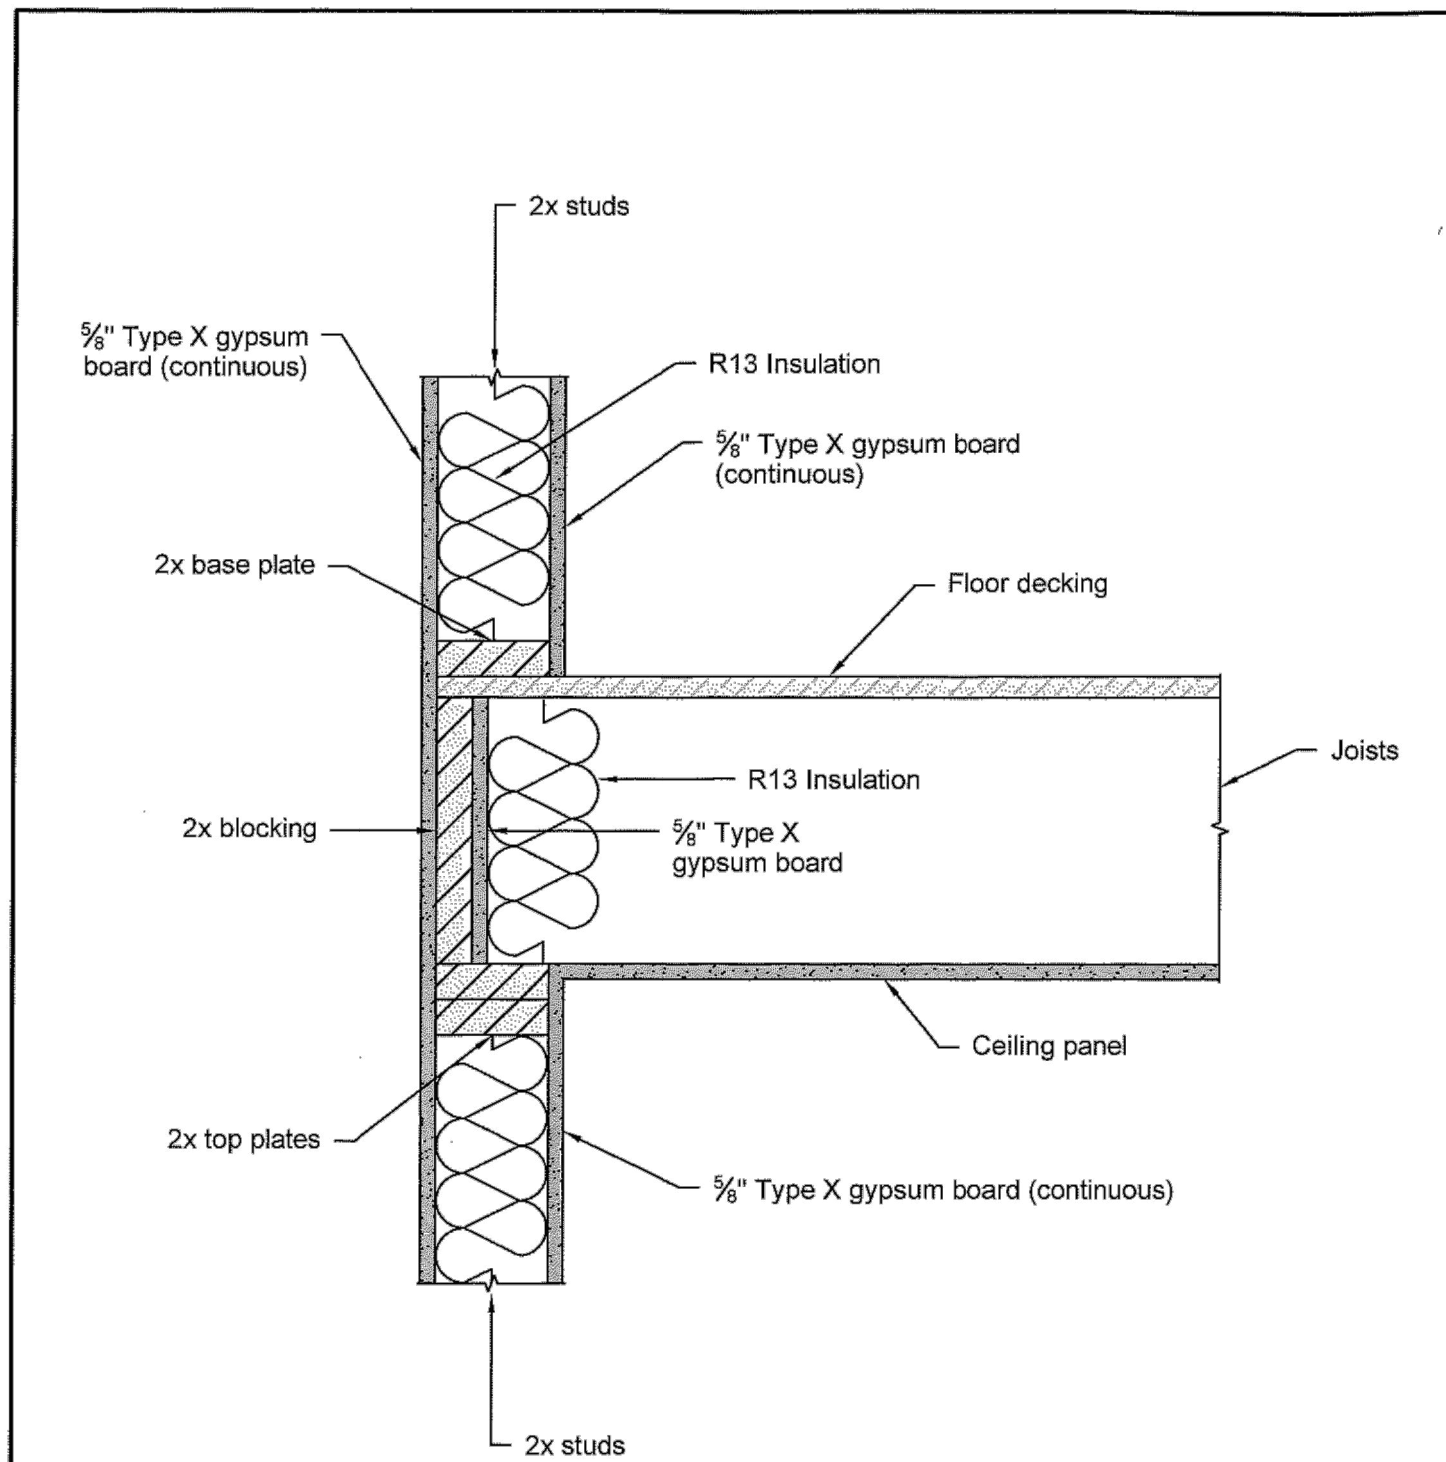

WALL SECTION
(Not to scale)

	STANDARD DRAWING CITY OF HOUSTON DEPARTMENT OF PUBLIC WORKS & ENGINEERING	MEMBRANE PENETRATION OF A ONE-HOUR-RATED EXTERIOR WALL 1002 WASHINGTON AVE., HOUSTON, TEXAS 77002	APPROVED BY: BUILDING OFFICIAL DATE: 5/25/18 DWG NO: 18-04-M
--	---	--	---

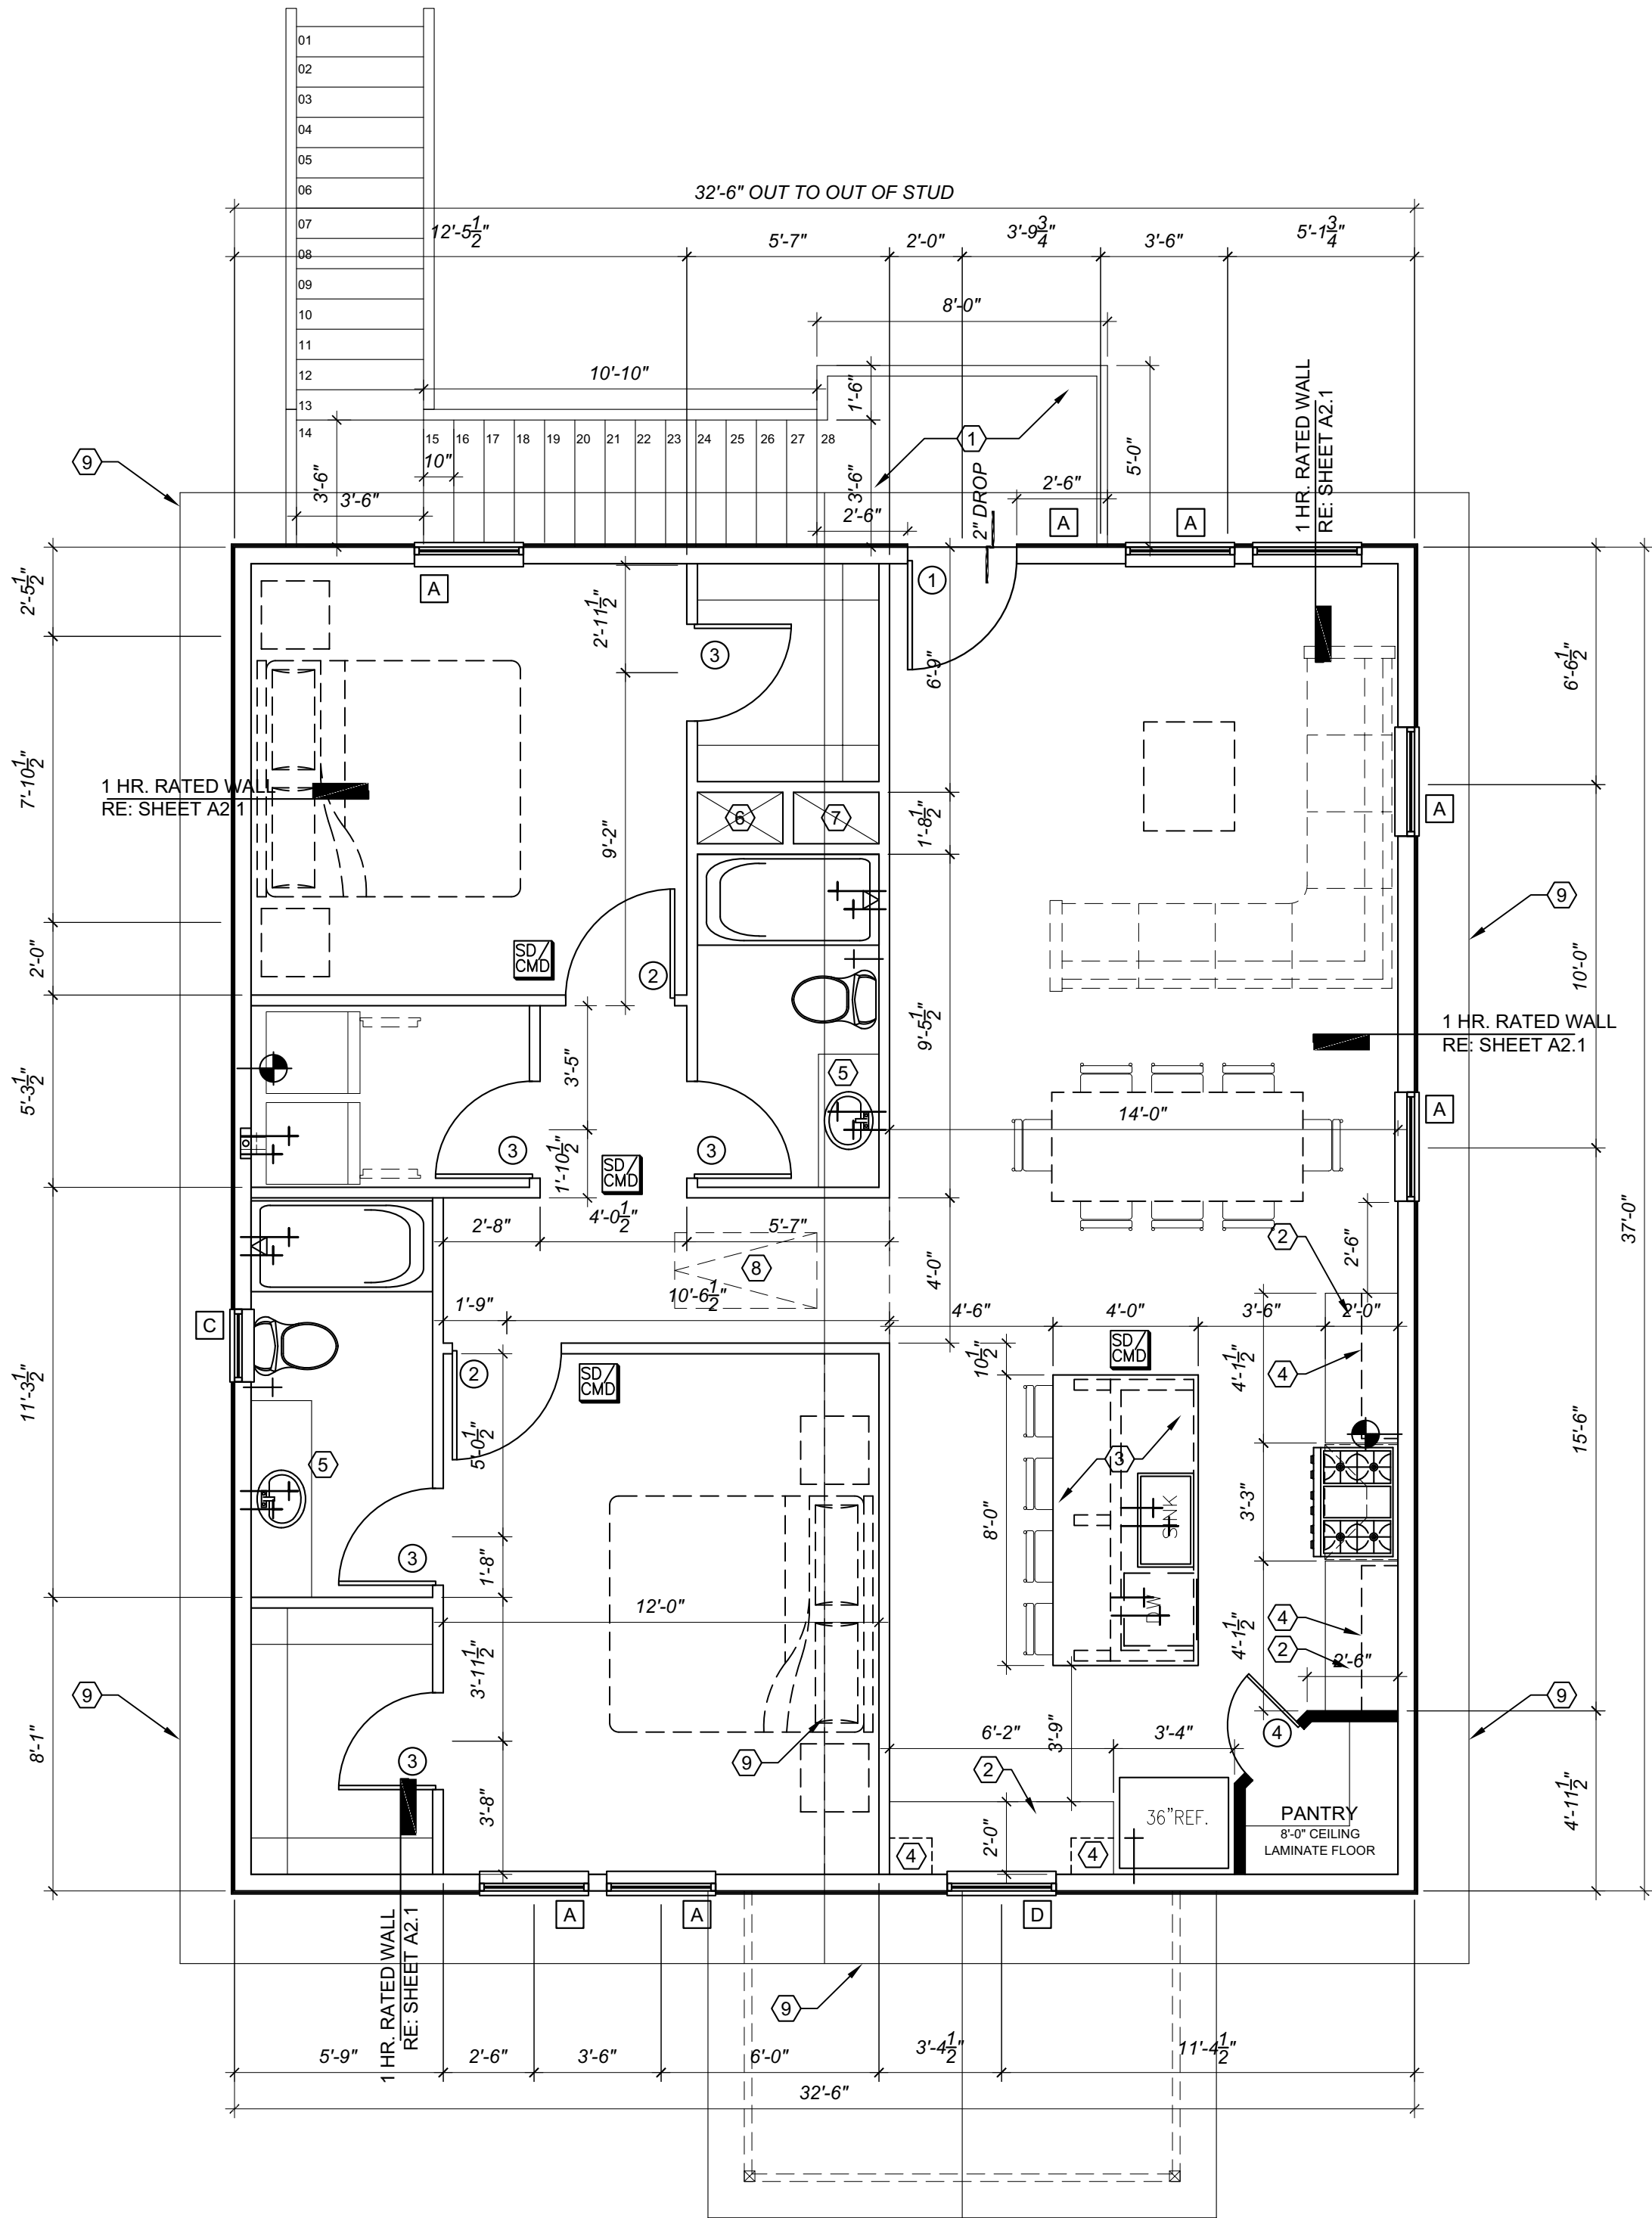

PROPOSED SECOND FLOOR PLAN

SCALE: 1/4" = 1'-0"
(EXPOSED WOOD TO BE PRESSURE TREATED)

DATE	DESCRIPTION
01/25/24	FOR PERMIT

PROJECT LOCATION:
TWO FAMILY RESIDENCE
PROPOSED TWO STORY DUPLEX
5217 - A & B PICKFAIR ST
HOUSTON, TEXAS 77026

JOB NO: 23016.01

SCALE:

DATE: 01/24/24

SHEET NO:

A2.2